



NEAR EAST UNIVERSITY

Faculty of Engineering

**Department of Electrical and Electronic
Engineering**

FOTOSEL CONTROL USING PLC

**Graduation Project
EE- 400**

Student: LAMİH ODABAŞI (970446)

Supervisor: Mr. Özgür Cemal Özerdem

Nicosia-2003



ACKNOWLEDGEMENTS

Foremost I would like to pay my special thanks to my parents, who helped me on every phase of my life. They boosted me up about my studies as well as my life. I am very much thankful and grateful to my mother whose prayers and love for me has encouraged me so make this day come true. It is only because of them that today I am capable of completing my degree.

Secondly I would like to thank to my supervisor Mr. Özgür Cemal Özerdem without whom this project would have not been possible. Whose words of encouragement kept us doing my project. His faith in my work and me and his invaluable knowledge for the project has made me taking keen interest in my project. He is an excellent teacher and advisor.

I would also like to thank my all friends and housemate who helped me so much in doing my project. They encouraged me allot in completing my project, as it is not single man's work. I want to thank them as they contributed their time and provided very helpful suggestions.

ABSTRACT

As PLC technology has advanced, so have programming languages and communications capabilities, along with many other important features. Today's PLCs offer faster scan times, space efficient high-density input/output systems, and special interfaces to allow non-traditional devices to be attached directly to the PLC. Not only can they communicate with other control systems, they can also perform reporting functions and diagnose their own failures, as well as the failure of a machine or process. Size is typically used to categorize today's PLC, and is often an indication of the features and types of applications it will accommodate.

In this project CPU 212 8 inputs, 6 outputs, 24 volt DC input 220 Volt AC output PLC is used, and an automation of a Lamp and an industrial motor is realized by PLC programs.

Real life experimental operation is performed and the Lamp and AC motor is physically operated.

TABLE OF CONTENTS

ACKNOWLEDGMENT	i
ABSTRACT	ii
CONTENTS	iii
INTRODUCTION	1
1. PROGRAMMABLE LOGIC CONTROLLERS	2
1.1. History of PLC	2
1.2 . What is a PLC?	3
1.3 . General Physical Build Mechanism	5
1.3.1. Compact PLC's	5
1.3.2. Modular PLC's	5
1.4. Programmable Controller	5
1.4.1. Overview	5
1.4.2. Background	6
1.4.3. Terminology-PC or PLC	8
1.4.4. PLC Hardware Design	8
1.5. Types of PLC	14
1.5.1. Small PLC's	15
1.5.2. Medium-sized PLC's	16
1.5.3. Large PLC	17
1.5.4. Remote input/output	18
1.5.5 Programming large PLC's	18
1.5.6. Developments	19
1.6.Today's PLC	19
2. AN OVERVIEW OF SIEMENS S7-200 MICRO CONTROLLER	20
2.1. Overview of an S7-200	20
2.2. Introduction to the Simatic S7-200 Micro PLC	20
2.3. Comparing the Features of the S7-200 Micro PLCs	21

2.3.1. Equipment Requirements	21
2.3.2. Capabilities of the S7-200 CPUs	21
2.4. Major Components of the S7-200 Micro PLC	22
2.4.1. CPU Module	22
2.4.2. Expansion Modules	24
2.5. Programming Languages	24
2.5.1. Ladder Programs	24
2.5.2. STL Programs	25
2.6. CPU Memory	25
2.7. Simatic S7-200 Application Areas	25
2.7.1. The S7-200 is characterized by the following properties	26
2.7.2. Mechanical features include	27
2.7.3. Design features	27
2.7.4. Benefits of the S7-200	27
2.8 Advantages	28
2.8.1. Accuracy	28
2.8.2. Data Areas	29
2.8.3. Logic Control of Industrial Automation	29
2.8.4. Data Object	29
2.8.5. Flexibility	30
2.8.6. Communication	30
3.PRACTICAL IMPLEMENTATION WITH PLC	31
3.1. Overview	31
3.1.1 Explanation of the Networks that will be used in the operation	31
3.1.2. Statement List of the PLC Program	32
3.1.3. Ladder Diagram of the PLC Program	33
3.2. The View of SIMATIC S7-200 PLC Program	34
4. CARD	36
4.1. Machine Card	37
4.1.1. Logic Program	38
4.1.2. Program Titel Comments	39
4.2. Destruction Machine	40

4.2.1. Logic Program	41
4.2.2. Program Titel Comments	42
CONCLUSION	43
REFERENCES	44

INTRODUCTION

A Programmable Logic Controller was defined by Capiel (1982) as:

“ A digitally operating electronic system designed for use in an industrial environment, which uses a programmable memory for the internal storage of instructions for implementing specific functions such as logic, sequencing, timing, counting and arithmetic to control through analog or digital input/output modules, various types of machines or processes.” Which explains the device perfectly.

In the late 1960's PLC's were first introduced. The first PLC can be traced back to 1968 when Bedford Associates, a company in Bedford, MA, developed a device called a Modular Digital Controller for General Motors (GM). The MODICON, as it was known, was developed to help GM eliminate traditional relay-based machine control systems.

The aim of this thesis is the control of the Lamp and AC Motor with SIMATIC S7-200 MICRO/WIN PLC.

The Thesis consists of the introduction, three chapters, and conclusion.

The Chapter-1 presents History of PLC, What is PLC?, Types of PLC's Hardware of PLC's, and chapter concluded with a brief information about Today's PLC's.

Chapter-2 presents the informations about Siemens SIMATIC S7-200 PLCs and application areas of this type of PLCs.

Chapter-3 presents a practical implementation about Lamp and AC motor Control with PLC program.

CHAPTER ONE

1. PROGRAMMABLE LOGIC CONTROLLERS

1.1 HISTORY OF PLC

The first PLC can be traced back to 1968 when Bedford Associates, a company in Bedford, MA, developed a device called a Modular Digital Controller for General Motors (GM). The MODICON, as it was known, was developed to help GM eliminate traditional relay-based machine control systems. Because relays are mechanical devices, they have limited lifetimes. They are also cumbersome, especially in large applications where thousands of them may exist. With so many relays to work with, wiring and troubleshooting could be quite complicated. Since the MODICON was an electronic device, not a mechanical one, it was perfect for GM's requirements, as well as for many other manufacturers and users of control equipment. With less wiring, simpler troubleshooting, and easy programming, PLC technology caught on quickly. In the late 1960's PLC's were first introduced. The primary reason for designing such a device was eliminating the large cost involved in replacing the complicated relay based machine control systems. Bedford Associates (Bedford, MA) proposed something called a modular digital controller (MODICON) to a major US car manufacturer. Other companies at the time proposed computer based upon the PDP - 8. The MODICON 084 brought the world's first PLC into commercial production. When production requirements changed so did the control system. This becomes very expensive when the change is frequent. Since relays are mechanical devices they also have a limited lifetime that required strict adhesion to maintenance schedules. Troubleshooting was also quite tedious when so many relays are involved. Now picture a machine control panel that included many, possible hundreds or thousands, of individual relays. The size could be mind-boggling. How about the complicated initial wiring of so many individual devices! These relays would be individually wired together in a manner that would yield the desired outcome. These new controllers also had to be easily programmed by maintenance and plant engineers. The lifetime had to be long and programming changes easily performed. The also had to survive the harsh industrial environment. That's a lot to ask! The answers were to use a programming technique most people were already familiar with and replace mechanical parts with solid-state ones.

In the mid70's the dominant PLC techniques were sequencer state machines and the bit-slice based CPU. The AMD 2901 and 2903 were quite popular in MODICON and A-B PLC's. Conventional microprocessors lacked the power to quickly solve PLC logic in all but

the smallest PLC's. As conventional microprocessors evolved, larger and larger PLC's were being based upon them. However, even today some are still based upon the 2903. MODICON has yet to build a faster PLC than their 984A/B/X, which was based upon the 2901.

Communications abilities began to appear in approximately 1973. The first such system was MODICON's MODBUS. The PLC could now talk to other PLC's and they could be far away from the actual machine they were controlling. They could also now be used to send and receive varying voltages to allow them to enter the analogue world. Unfortunately, the lack of standardization coupled with continually changing technology has made PLC communications a nightmare of incompatible protocols and physical networks.

The 80's saw an attempt to standardize communications with General Motor's manufacturing automation protocol. It was also a time for reducing the size of the PLC and making them software programmable through symbolic programming on personnel computers instead of dedicated programming terminals or handheld programmers.

The 90's have seen a gradual reduction in the introduction of new protocols, and the modernization of the physical layers of some of the more popular protocols that survived the 1980's. The latest standard has tried to merge PLC- programming languages less than one international standard. We now have PLC's that are programmable in function block diagrams, instruction list, C and structured text all at the same time! PC's are also being used to replace PLC's in some applications. The original company who commissioned the MODICON 084 has actually switched to a PC based control system.

1.2 WHAT IS A PLC ?

PLCs are often defined as miniature industrial computers that contain hardware and software that is used to perform control functions. A PLC consists of two basic sections: the central processing unit (CPU) and the input/output interface system. The CPU, which controls all PLC activity, can further be broken down into the processor and memory system. The input/output system is physically connected to field devices (e.g., switches, sensors, etc.) and provides the interface between the CPU and the information providers (inputs) and controllable devices (outputs). To operate, the CPU "reads" input data from connected field devices through the use of its input interfaces, and then "executes", or performs the control program that has been stored in its memory system. Programs are typically created in ladder logic, a language that closely resembles a relay-based wiring schematic, and are entered into the CPU's memory prior to operation. Finally, based on the program, the PLC "writes", or

updates output devices via the output interfaces. This process, also known as scanning, continues in the same sequence without interruption, and changes only when a change is made to the control program.

A programmable logic controller (PLC) is a device that was invented to replace the necessary sequential relay circuits for machine control. The PLC works by looking at its inputs and depending upon their state, turning on / off its outputs. The user enters a program, usually via software, that gives the desired results.

PLC's are used in many real world applications. If there is industry present, changes are good that there is a PLC present. If you are involved in machining, packaging material handling, and automated assembly or countless other industries you are probably already using them. If you are not, you are wasting money and time. Almost any application that needs some type of electrical control has a need for PLC.

For example, let's assume that when a switch turned on, we want turn on a solenoid for 5 seconds and then turn it off regularly of how long the switch is on. We can do this with a simple external timer. But what will happen if the process included 10 switches and solenoids? We would need 10 external timers. What will happen if the process also needed to count how many times the switches individually turned on? We would need a lot of external counters.

As you see, if the process becomes more complicated, then we have to use a device the simplify that. We use PLC for this process. We can program the PLC to count its inputs and turn the solenoids for the specified time.

This site gives you enough information to be able to write programs for more complicated then the simple than above. We will take a look at what is considered to be the 'top 20' PLC instructions. It can be safely estimated that with affirm understanding of these instructions, that just one of them can solve more than 80 % of the applications in existence.

1.3.GENERAL PHYSICAL BUILD MECHANISM

PLC's are separated into two according to their building mechanisms.

1.3.1 Compact PLC'S

Compact PLC's are manufactured such that all units forming the PLC are placed in a case. They are low price PLC with lower capacity. Small or medium size machine manufacturers usually prefer them. In some types compact enlargement module is present.

1.3.2 Modular PLC's

Combining separate modules together in a board forms them. They can have different memory capacity, I / O numbers, power supply up to the necessary limits.

Some examples: SIEMENS S5-115U, SIEMENS S7-200, MITSUBISHI PC40, TEXAS INSTRUMENT PLC'S, KLOCKNER-MOELLER PS316, OMRON C200H.

1.4 PROGRAMMABLE CONTROLLER

1.4.1 Overview

The need for low cost, versatile and easily commissioned controllers has resulted in the development of programmable-control systems standard units based on a hardware CPU and memory for the control of machines or processes. Originally designed as a replacement for the hard-wired relay and timer logic to be found in traditional control panels, PLC's provides ease and flexibility of control based on programming and executing simple logic instructions. PLC's have internal functions such as timers, counters and shift registers, making sophisticated control possible using even the smallest PLC.

A programmable control operates by examining the input signals from a process and carrying out logic instructions on these input signals, producing output signal to drive process equipment or machinery. Standard interfaces build into PLC's allow them to be directly connected to process actuators and transducers (pumps and valves) without the need for intermediate circuitry or relays.

Through using PLC's it became possible to modify a control system without having the disconnect or re-route a signal wire. It was necessary to change only the control program using a keypad or VDU terminal. Programmable controllers also require shorter installation and commissioning times than do hardwired systems. Although PLC's are similar to conventional computers in terms of hardware technology, they have specific features suited to industrial control:

- Rugged, noise immune equipment;
- Modular plug-in construction, allowing easy replacement\addition of units (input\output);
- Standard input\output connections and signal levels;
- Easily understood programming language (ladder diagram and function chart),
- Ease of programming and reprogramming in-plant.

These features make programmable controllers highly desirable in a wide variety of industrial-plant and process-control situations.

1.4.2 Background

The programmable controller was initially conceived by a group of engineers from General Motors in 1968, where an initial specification was provided: the controller must be:

1. Easily programmed and reprogrammed, preferably in-plant to alter its sequence of operations.
2. Easily maintained and repaired- preferably using plug-in modules.
 - a) More reliable in plant environment.
 - b) Smaller than it is relay equivalent.
3. Cost competitive, with solid-state and relay panels than in use.

This provoked a keen interest from engineers of all disciplines in how to PLC could be used for industrial control. With this came demands for additional PLC capabilities and facilities, which were rapidly implemented as the technology became available. The instruction sets quickly moved from simple logic instructions to include counters, timers and shift registers, than onto more advanced mathematical functions on the machines. Developments hardware were also occurring, with larger memory and greater numbers of input / output points featuring on new models. In 1976 became possible to control remote I / O racks, where large numbers of distant I / O points were monitored updated via a communications link, often several hundred meters from the main PLC. The Allan-Bradley Corporation in America introduced a microprocessor-based PLC in 1977. It was based on an 8080 microprocessor but used an extra processor to handle bit logic instruction at high speed.

The increased rate of application of programmable controllers within industry has encouraged manufacturers to develop whole families of microprocessor-based systems having various levels of performance. The range of available PLC's now extends from small self-contained units with 20 digital I / O points and 500 program steps, up to modular systems with add-on function modules:

- Analogue I/O;
- PID control (proportional, integral and derivative terms);
- Communications;
- Graphics display;
- Additional I/O;
- Additional memory.

This modular approach allows the expansion or upgrading of a control system with minimum cost and disturbance.

Programmable controllers are developing at a virtually the same pace as microcomputers, with particular emphasis on small controllers, positioning numeric control and communication networks. The market for small controllers has grown rapidly since the early 1980's when a number of Japanese companies introduced very small, low cost units that were much cheaper than others available at that time. This brought programmable controllers within the budget of many potential users in the manufacturing and process industries, and this trend continues with PLC's offering ever-increasing performance at ever-decreasing cost.

The Mitsubishi F40 PLC is a typical example of a modern small PLC, providing 40 I / O points, 16 timers and counters, plus other functions. The controller uses a microprocessor and has 890 RAM locations for user programs. The 24-input channels of the F40 operate at 24 V d.c. Whilst 16 outputs may be 24 V d.c. or 240 V a.c. to provide easy interfacing to industrial equipment.

1.4.3. Terminology-PC or PLC

There are several different terms used to describe programmable controllers, most referring to the functional operation of the machine in question:

- PC programmable controller
- PLC programmable logic controller
- PBS programmable binary system

By their nature these terms tend to describe controllers that normally work in a binary environment. Since all but the smallest programmable controllers can now be equipped to process analogue inputs and outputs these labels are not representative of their capabilities. For these reasons the overall term programmable controller has been widely adopted to

describe the family of freely programmable controllers. However, to avoid confusion with the personal computer PC, this text uses the abbreviation PLC for programmable (logic) controller.

1.4.4. PLC Hardware Design

Programmable controllers are purpose-built computers consisting of three functional areas:

- Processing:
- Memory:
- Input / output:

Input conditions to the PLC are sensed and then stored in the memory, where the PLC performs the programmed logic instructions on these input states. Output conditions are then generated to drive associated equipment. The action taken depends totally on the control program held in memory.

In smaller PLC these functions are performed by individual printed circuit cards within a single compact unit, whilst larger PLC's are constructed on a modular basis with function modules slotted in to the back plane connectors of the mounting rack.

This allows simple expansion of the system when necessary. In both these cases the individual circuit board are easily removed and replaced, facilitating rapid repair of the system should faults develop.

In addition a programming unit is necessary to download control programs to the PLC memory.

a) Input output / units

Most PLC'S operate internally at between 5 and 15 V d.c. (Common TTL and CMOS voltages), whilst process signals much greater, typically 24 V d.c. to 240 V a.c. at several amperes.

The I / O units form the interface between the microelectronics of the programmable controller and real world outside, and must therefore provide all, necessary signal conditioning and isolation functions. This often allows a PLC to be directly connected to process actuators and transducers (pumps and valves) without the need for intermediate circuitry and relays.

To provide this signal conversion programmable controllers are available with a choice of input / output units to suit different requirements.

For example:

Inputs: 5 V (TTL level) switched I/ P
 24 V switched I/ P
 110 V switched I/ P
 240 v switched I/ P

Outputs: 24 V 100 mA switched O/ P
 110 V 1mA
 240 V 1 A a.c. (triac)
 240 V 2 A a.c. (relay)

It is standard practice for all I/O channels to be electrically isolated from the controlled process, using opto-isolator circuits on the I/O modules. An opto-isolator circuit consists of a light emitting diode and a phototransistor, forming an opto coupled pair that allows small signals to pass through, but will clamp any high voltage spikes or surges down to the same small level. This provides protection against switching transients and power-supply surges, normally up to 1500V.

In small self contained PLC's in which all I/ O points are physically located on the one casing, all inputs will be of one type (e.g. 24 V) and the same for outputs (e.g. all 240 V triac). This is because manufacturers supply on the standard function boards for economic reasons. Modular PLC's have greater flexibility of I/ O, however, since the user can select from several different types and combinations of input and output modules.

In all cases the input/output units are designed with the aim of simplifying the connections of process transducers and actuators to the programmable controller. For these purposes all PLC'S are equipped with standard screw terminals or plugs on every I/O point, allowing the rapid and simple removal and replacement of a faulty I/ O card. Every input/output point has a unique address or channel number, which is used during program development to specify the monitoring of an input or the activating of a particular output within the program. Indication of the status of input/output channels is provided by light-emitting diode (LED's) on the PLC or I/ O unit, making it simple to check the operation of process inputs and outputs from the PLC itself.

b) Central Processing Unit (CPU)

The CPU controls and supervises all operations within the PLC, carrying out programmed instructions stored in memory. An internal communications highway or bus system carries information to and from the CP, memory and I/ O units, under control of the CPU. The CPU is supplied with a clock frequency by an external quartz crystal or RC oscillator, typically between 1 and 8 megahertz depending on the microprocessor used and the area of application.

The clock determines the operating speed of the PLC and provides timing/synchronization for all elements in the system. Virtually all modern programmable controllers are microprocessor based using a micro as a system CPU. Some larger PLC's also employ additional microprocessor to control complex, time-consuming functions such as mathematical processing, three terms PID control.

c) Memory

- For program storage all modern programmable controllers use semiconductor memory devices such as RAM read/write memory, or a programmable read-only memory of the EPROM or EEPROM families.

In the virtually all cases RAM is used for initial program development and testing, as it follows changes to be easily made in program. The current trend is to be providing CMOS RAM because of it is very low power consumption, to provide battery back up to this RAM in order to maintain the contents when the power is removed from the PLC system. This battery has a lifespan of at least one year before replacement is necessary, or alternatively a rechargeable type may be supplied with the system being recharge whenever the main PLC power supply is on.

This feature makes programs stored in RAM virtually permanent. Many users operate their PLC systems on this basis alone, since it permits future program alterations if and when necessary.

After a program is fully developed and tested it may be loaded (blown) into a PROM or EPROM memory chip, which are normally cheaper than RAM devices. PROM programming is usually carried out with a special purpose programming unit, although many programmable controllers now have this facility built-in, allowing programs in the PLC RAM to be down loaded into a PROM IC placed in a socket provided on the PLC itself.

In addition to program storage, a programmable controller may require memory for other functions:

- 1- Temporary buffer store for input/output channels status- I/ O RAM
- 2- Temporary storage for status of internal function (timers, counters, marker relays)

Since these consist of changing data they require RAM read/write memory, which may be battery-backed in sections.

d) Memory size

Smaller programmable controllers normally have a fixed memory size, due in part to the physical dimensions of the unit. This varies in capacity between 300 and 1000 instructions depending on the manufacturer. This capacity may not appear large enough to be very useful, but it has been estimated that 90 % of all binary control tasks can be solved using less than 1000 instructions, so there is sufficient space to meet most users needs.

Larger PLC's utilize memory modules of between 1K and 64K in size, allowing the system to be expanded by fitting addition RAM or PROM memory cards to the PLC rack.

As integrated circuit memory costs continue to fall, the PLC manufacturers are providing larger program memories on all products.

e) Logic instruction set

The most common technique for programming small PLC's is to draw a ladder diagram of the logic to be used, and then convert this in to mnemonic instructions, which will be keyed in to programming panel attached to the programmable controller. These instructions are similar in appearance to assembly-type codes, but refer to physical inputs, outputs and functions within the PLC itself.

The instruction set consists of logic instructions (mnemonics) that represent the actions that may be performed within a given programmable controller. Instructions sets vary between PLC's from different manufacturers, but are similar in terms of the control actions performed.

Because the PLC logic instruction set tends to be small, it can be quickly mastered and used by control technicians and engineers.

Each program instructions are made up of two parts: a mnemonic operation component or opcode, and an address or operand component that identifies particular elements

(E.g. outputs) within the PLC.

For example;

Opcode	Operand
OUT	Y430
Device symbol	Identifier

Here the instruction refers to output (Y) number 430

f) Input/output numbering

These instructions are used the program logic control circuits that have been designed in ladder diagram form, by assigning all physical inputs and outputs with an operand suitable to the PLC being used. The numbering system used differs between manufacturers, but certain common terms exist. For example, Texas instrument and Mitsubishi use the symbol X to represent inputs, and Y to label outputs.

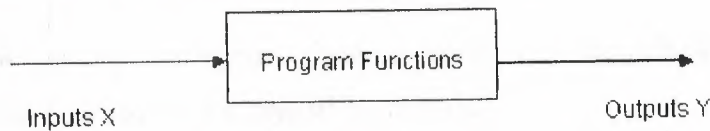


Figure 1.1 Programmable Controller

A range of addresses will be allocated to particular elements: for example

Mitsubishi F40 PLC: 24 inputs: X400 – 407, 410 – 413
X500 – 507, 510 – 513

16 Outputs: Y430 – 437
Y530 – 537

Inspections of these numbers ranges will reveal that there is no overlap of addresses between functions; that is, 400 must be an input, 533 must be an output. Thus for these programmable controllers the symbol X or Y is redundant, being used purely for the benefit of the user, who is unlikely to remember what element 533 represents. However, for many PLC's both parts of the address are essential, since the I/O number ranges are identical. For example the Klockner-Moeller range of controllers:

Sucos PS 21 PLC: 8 inputs I0 to 7, etc. 8 Outputs Q0 to 7, etc

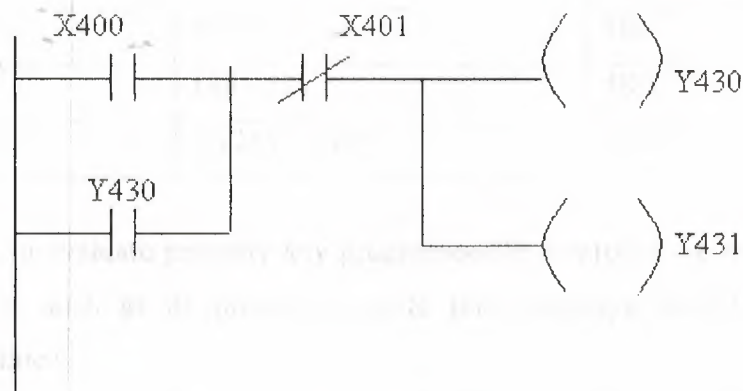


Figure 1.2 Ladder Diagram

To program the ladder diagram given in figure 1.2, the following code would be written, and then programmed in to a keypad or terminal.

1. LD X400 starts a rung with a normally open contact
2. OR Y430 connect a normally open contact in parallel
3. ANI X401 connect a normally closed contact in series
4. OUT Y430 drive an output channel
5. OUT Y431 drive another channel
6. END end of program-return to start

Notice the contact Y430 that forms a latch across X400. The Y contact is not a physical element, but is simulated within the programmable controller and will operate in unison with the output point Y430. The programmer may create as many contacts associated with an output as necessary.

1.5. Types Of PLC

The increasing demand from industry for programmable controllers that can be applied to different forms and sizes of control tasks has resulted in most manufacturers producing a range of PLC's with various levels of performance and facilities.

Typical rough definitions of PLC size are given in terms of program memory size and the maximum number of input/output points the system can support. Table 7.1 gives an example of these categories.

Table1.1 Categories of PLC

PC size	Max I \ O points	Use memory size
Small	40 / 40	1K
Medium	128 / 128	4K
Large	> 128 / > 128	> 4K

However, to evaluate properly any programmable controller we must consider many additional features such as its processor, cycle time language facilities, functions, and expansion capabilities.

A brief outline of the characteristics of small, medium of large programmable controller is given below, together with typical applications.

1.5.1. Small PLC's

In general, small and 'mini' PLC's are designed as robust, compact units, which can be mounted on or beside the equipment to be controlled. They are mainly used the replaced hard-wired logic relays, timers, counters. That control individual items of plant or machinery, but can also be used to coordinate several machines working in conjunction with each other.

Small programmable controllers can normally have their total I/ O expanded by adding one or two I/ O modules, but if any further developments are required this will often mean replacement of the complete unit. This end of the market is very much concerned with non-specialist and users, therefore ease of programming and a 'familiar' circuit format are desirable. Competition between manufacturers is extremely fierce in this field, as they vie to obtain a maximum share in this partially developed sector of the market.

A single processor is normally used, and programming facilities are kept a fairly basic level, including conventional sequencing controls and simple standard functions: e.g. timers and counters. Programming of small PLC's is by way of logic instruction list (mnemonics) or relay ladder diagrams.

Program storage is given by EPROM or battery-backed RAM. There is now a trend towards EEPROM memory with on-board programming facilities on several controllers.

Table 1.2 Features of a typical small PLC – Mitsubishi F20

Electrical: 240 V a.c. supply;
24 V d.c. On-board for input requirements;
12 inputs, 8 output points;
LED indicators on all I/ O points;
All I/O Opto-isolated
Choice of output: Relay (240 V 2 a rated)
Triac (240 V 1 A rated)
Transistor (24 V d.c. 1 A)
320 – step memory (CMOS battery-backed RAM)

Programming: Ladder logic or instruction set using hand-held or graphic LCD programmer, with editor, test and monitor facilities;

Facilities:

- 8 counters, range 1-99 (can be cascaded)
- 8 timers, range 0.1-99s (can be cascaded)
- 64 markers\auxiliary relays; can be used individually or in blocks
- Forming shift registers;
- Special function relays;
- Jump capability.

1.5.2 Medium-sized PLC's

In this range modular construction predominates with plug-in modules based around the Euro card 19-inch rack format or another rack mounting system. This construction allows the simple upgrading or expansion of the system. This construction allows the simple upgrading or expansion of the system by fitting additional I/ O cards in to the cards into the rack, since most rack, systems have space for several extra function cards. Boards are usually 'rugged zed' to allow reliable operation over a range of environments.

In general this type of PLC is applied to logic control tasks that can not be met by small controllers due to insufficient I/O provision, or because the control task is likely to be extended in the future. This might require the replacement of a small PLC, where as a

modular system can be expanded to a much greater extent, allowing for growth. A medium-sized PLC may therefore be financially more attractive in the long term.

Communications of a single and multi-bit processor are likely within the CPU. For programming, standard instructions or ladder and logic diagrams are available. Programming is normally carried out via a small keypad or a VDU terminal. If different sizes of PLC are purchased from a single manufacturer, it is likely that programs and programming panels will be compatible between the machines.

1.5.3 Large PLC

Where control of very large numbers of input and output points is necessary and complex control functions are required, a large programmable controller is the obvious choice. Large PLC's are designed for use in large plants or on large machines requiring continuous control. They are also employed as supervisory controllers to monitor and control several other PLC's or intelligent machines. e.g. CNC tools.

Modular construction in Euro card format is standard, with a wide range of function cards available including analogue input output modules. There is a move towards 16-bit processor, and also multi-processor usage in order to efficiently handle a large range of differing control tasks.

For example;

- 16-bit processor as main processor for digital arithmetic and text handling.
- Single-bit processor as co-or parallel processor for fast counting, storage etc.
- Peripheral processor for handling additional tasks which are time-dependent or time-critical, such as:
 - Closed-loop (PID) control
 - Position controls
 - Floating-point numerical calculations
 - Diagnostic and monitoring
 - Communications for decentralized
 - Remote input/output racks.

This multi-processor solution optimizes the performance of the overall system as regards versatility and processing speed, allowing to PLC to handle very large programs of 100 K instructions or more. Memory cards can now provide several megabytes of CMOS RAM or EPROM storage.

1.5.4. Remote input/output

When large numbers of input / output points are located a considerable distance away from the programmable controller, it is uneconomic to run connecting cables to every point. A solution to this problem is to site a remote I/ O unit near to the desired I/ O points. This acts as a concentrator to monitor all inputs and transmit their status over a single serial communications link to the programmable controller. Once output signals have been produced by the PLC they are feedback along the communications cable to the remote I/ O unit, which converts the serial data into the individual output signals to drive the process.

1.5.5 Programming large PLC's

Virtually any function can be programmed, using the familiar ladder symbols via a graphics terminal or personal computer. Parameters are passed to relevant modules either by incorporating constants in to the ladder, or via on screen menus for that module.

There may in addition be computer-oriented languages, which allow programming of function modules and subroutines.

There is progress towards standardization of programming languages; with programs becoming easier to over-view through improvement of text handling, hand improved documentation facilities. This is assisted by the application of personal computers as workstations.

1.5.6. Developments

Present trends include the integration of process data from a PLC into management databases, etc. This allows immediate presentation of information to those involved in scheduling, production and planning.

The need to pass process information between PC's and PLC sand other devices within a automated plants has resulted in the provision of a communications capability on all but the smallest controller. The development of local area networks (LAN) and in particular the recent MAP specification by General Motors (manufacturing automation protocol) provides the communication link to integrate all levels of control systems.

1.6.Today's PLC

As PLC technology has advanced, so have programming languages and communications capabilities, along with many other important features. Today's PLCs offer faster scan times, space efficient high-density input/output systems, and special interfaces to allow non-traditional devices to be attached directly to the PLC. Not only can they communicate with other control systems, they can also perform reporting functions and diagnose their own failures, as well as the failure of a machine or process. Size is typically used to categorize today's PLC, and is often an indication of the features and types of applications it will accommodate. Small, non-modular PLCs (also known as fixed I/O PLCs) generally have less memory and accommodate a small number of inputs and outputs in fixed configurations. Modular PLCs have bases or racks that allow installation of multiple I/O modules, and will accommodate more complex applications. When you consider all of the advances PLCs have made and all the benefits they offer, it's easy to see how they've become a standard in the industry, and why they will most likely continue their success in the future.

CHAPTER TWO

2. AN OVERVIEW OF SIEMENS S7-200 MICRO CONTROLLER

2.1. Overview of an S7-200

STEP 7-Micro/WIN supports the S7-200 CPUs by giving you the features to set up and manage your application project. A project consists of the program you enter with STEP 7-Micro/WIN, along with the documentation you write for the program and the configuration you set up for the CPU.

You have the option of selecting either Ladder or Statement List as your programming language. With the S7-200 CPUs, you have a basic program structure that gives you flexibility in setting up any subroutines or interrupts that you program.

2.2. Introduction to the Simatic S7-200 Micro PLC

The Simatic S7-200 series is a line of micro-programmable logic controllers (Micro PLCs) that can control a variety of automation applications. Figure 2.1 shows an S7-200 Micro PLC. The compact design, expandability, low cost, and powerful instruction set of the S7-200 Micro PLC make a perfect solution for controlling small applications. In addition, the wide variety of CPU sizes and voltages provides you with the flexibility you need to solve your automation problems.

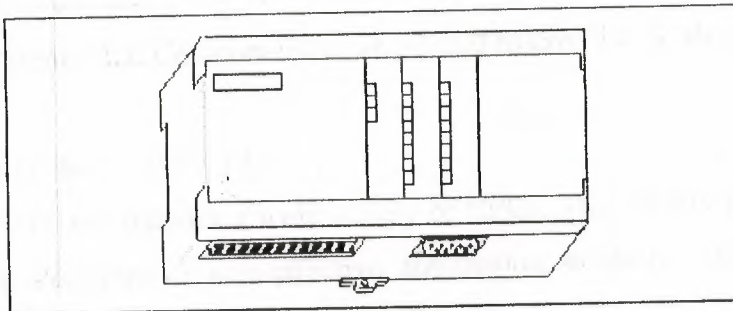


Figure 2.1. S7-200 Micro PLC

2.3. Comparing the Features of the S7-200 Micro PLCs

2.3.1 Equipment Requirements

Figure 2.2 shows the basic S7-200 Micro PLC system, which includes an S7-200 CPU module, a personal computer, STEP 7-Micro/WIN programming software, and a communications cable.

In order to use a personal computer (PC), you must have one of the following sets of equipment:

- A PC/PPI cable
- A communications processor (CP) card and multipoint interface (MPI) cable

A multipoint interface (MPI) card. A communications cable is provided with the MPI card.

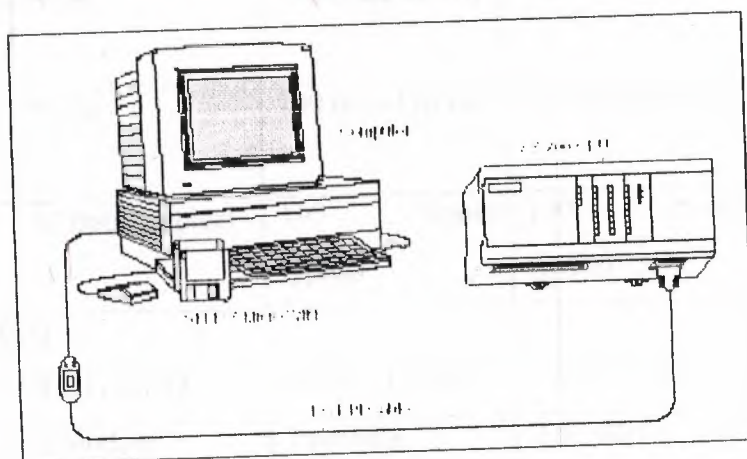


Figure 2.2. Components of an S7-200 Micro PLC System

2.3.2 Capabilities of the S7-200 CPUs

The S7-200 family includes a wide variety of CPUs. This variety provides a range of features to aid in designing a cost-effective automation solution. Table 2.1 provides a summary of the major features of each S7-200 CPU.

Table 2.1. Summary of the S7-200 CPUs

Feature	CPU 212	CPU 214	CPU 215	CPU 216
Physical Size of Unit	160 mm x 80 mm x 62 mm	197 mm x 80 mm x 62 mm	218 mm x 80 mm x 62 mm	218 mm x 80 mm x 62 mm
Memory				
Program (EEPROM)	512 words	2 Kwords	4 Kwords	4 Kwords
User data	512 words	2 Kwords	2,5 Kwords	2,5 Kwords
Internal memory bits	128	256	256	256
Memory cartridge	None	Yes (EEPROM)	Yes (EEPROM)	Yes (EEPROM)
Optimal battery cartridge	None	200 days typical	200 days typical	200 days typical
Backup (super capacitor)	50 hours typical	190 hours typical	190 hours typical	190 hours typical
Inputs/Outputs (I/O)				
Local I/O	8 DI / 6 DQ	14 DI / 10 DQ	14 DI / 10 DQ	24 DI / 16 DQ
Expansion modules (max.)	2 models	7 models	7 models	7 models
Process-image I/O register	64 DI / 64 DQ	64 DI / 64 DQ	64 DI / 64 DQ	64 DI / 64 DQ
Analog I/O (expansion)	16 AI / 16 AQ	16 AI / 16 AQ	16 AI / 16 AQ	16 AI / 16 AQ
Selectable input filters	No	Yes	Yes	Yes

2.4. Major Components of the S7-200 Micro PLC

An S7-200 Micro PLC consists of an S7-200 CPU module alone or with a variety of optional expansion modules

2.4.1. CPU Module

The S7-200 CPU module combines a central processing unit (CPU), power supply, and discrete I/O points into a compact, stand-alone device.

- The CPU executes the program and stores the data for controlling the automation task or process.
- The power supply provides electrical power for the base unit and for any expansion module that is connected.
- The inputs and outputs are the system control points: the inputs monitor the signals from the field devices (such as sensors and switches), and the outputs control pumps, motors, or other devices in your process.
- The communications port allows you to connect the CPU to a programming device or to other devices. Some S7-200 CPUs have two communications ports.

Status Lights provide visual information about the CPU mode (RUN or STOP), the current state of the local I/O, and whether a system fault has been detected.


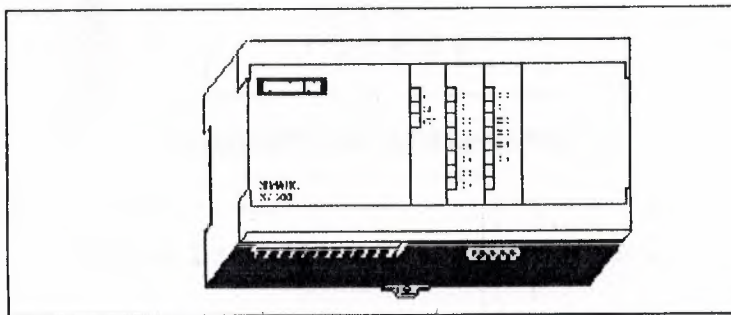


Figure 2.3 S7-212 CPU Module

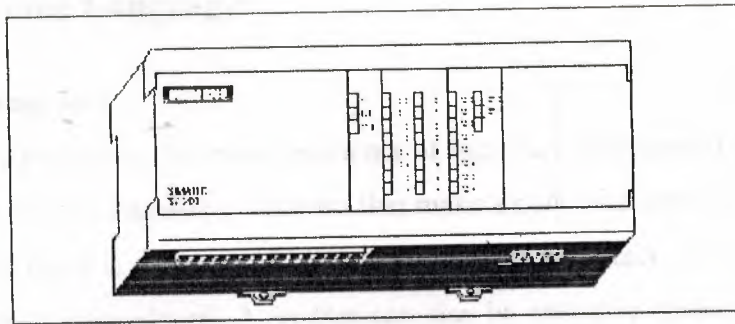

S7-214 CPU Module

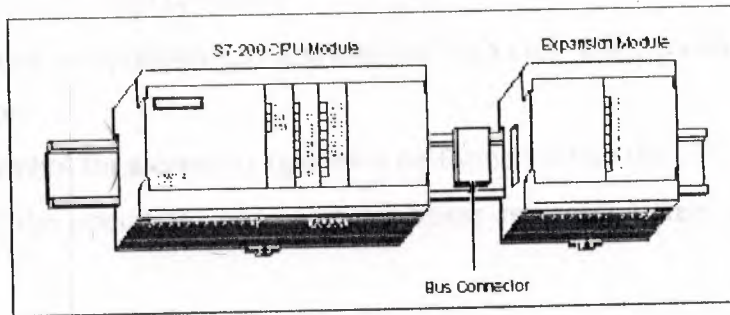


Figure 2.4 CPU Module with an Expansion Module

2.4.2. Expansion Modules

The 7-200 CPU module provides a certain number of local I/O. Adding an expansion module provides additional input or output points. As shown in Figure 2.4, the expansion module comes with a bus connector for connecting to the base unit.

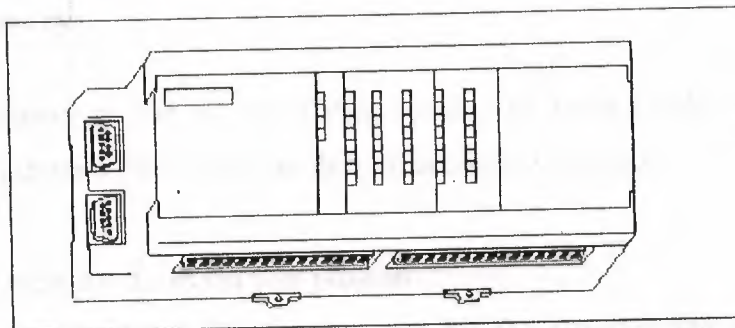


Figure 2.5 S7-215 and S7-216 CPU Module

2.5. Programming Languages

2.5.1. Ladder Programs

In Ladder programs, the basic elements of logic are represented with contacts, coils, and boxes. A set of interconnected elements that make a complete circuit is called a network.

A hard-wired input is represented by a symbol called a contact. A normally open contact enables power flow when closed. A contact can also be normally closed. In this case, power flow occurs when the contact is opened.

A hard-wired output is represented by a symbol called a coil. When a coil has power flow, the output is turned on.

A box is a symbol for a complex operation performed within the CPU. The box simplifies programming of the operation. For example, boxes represent timers, counters, and math operations.

2.5.2. STL Programs

STL program elements are represented by a set of instructions for performing the desired functions. Instead of using the graphic display as shown by ladder programs, the STL program is shown in text format.

2.6. CPU Memory

The user memory in the S7-200 CPUs consists of three blocks: program, data, and configurable parameters. The blocks are defined according to usage:

- Program memory stores the user program.
- Data memory includes a temporary area for the program and storage of data. The temporary storage, calculations, and constants reside in data memory. Additionally, data for timers, counters, high-speed counters, and analog inputs and outputs are stored in data memory.
- Configurable Parameter memory stores either the default or the modified parameters of the program setup. The configurable parameters include items such as protection level, password, station address, and retentive range information.

2.7. Simatic S7-200 Application Areas

The SIMATIC S7-200 series is a line of micro-programmable logic controllers (Micro PLCs) that can control a variety of automation applications. Compact design, low cost, and a powerful instruction set make the S7-200 controllers a perfect solution for controlling small applications. The wide variety of CPU sizes and voltages, and the windows-based programming tool, give you the flexibility you need to solve your automation problems.

2.7.1. The S7-200 is characterized by the following properties

- Easy entry
- Uncomplicated operation
- Peerless real-time characteristics
- Powerful communications capabilities

The S7-200 achieves its full performance potential in distributed automation solutions thanks especially to the integrated ProFi Bus-DP connection. The application area of the SIMATIC S7-200 extends from replacing simple relays and contactors right up to more complex automation tasks.

The S7-200 also covers areas where previously special electronics have been developed for cost reasons. Application areas include:

- Baling processes
 - Plaster & Cement mixers
 - Suction Plants
 - Centralized lubricating systems/flange lubricating systems
 - Woodworking machinery
 - Gate controls
 - Hydraulic lifts
 - Conveyor systems
 - Food & Drink Industry
 - Laboratories
 - Modem applications via dial-up, leased-line, or radio remote monitoring (SCADA)
- Electrical Installations

2.7.2. Mechanical features include

- Rugged, compact plastic housing using SIMATIC's prize-winning design
- Easily accessible wiring and operator control and display elements protected by front covers
- Installs on standard horizontal or vertical DIN rail or direct cabinet mounting with built-in mounting
- Terminal block as permanent wiring assembly (optional)

2.7.3. Design features

- International standards; Meets the requirements through compliance with VDE, UL, CSA and FM standards.
- The quality management system used during manufacturing has ISO 9001 certification; and Data back up; the user program and the most important parameter settings are stored in the internal EEPROM. A heavy-duty capacitor provides additional back up for all data over longer periods (typically up to 50 or 190 hours). An optional battery module ensures that the data remain stored for 200 days (typically) after power failure.

2.7.4. Benefits of the S7-200

Complete Automation Solution

The SIMATIC S7-200 Micro PLC is a full-featured programmable logic control system offering stand-alone CPUs, micro-modular expansion capability, and operator interface solutions. Almost any application that requires automation, from basic discrete or analog control, to intelligent networked solutions, can benefit by using the powerful S7-200 family of products.

Value for OEMs

Wherever central controllers or expensive custom electronic control systems are used, the SIMATIC S7-200 offers a significantly more economical alternative. Our off-the-shelf, compact solution, is packed with features, and is accepted around the world as a Micro PLC standard.

Real-time Speed & Versatility

The SIMATIC S7-200 offers real-time control with Boolean processing speeds of $0.37\mu\text{s}$ per instruction. This fast execution speed, combined with our 20Khz high-speed counters, interrupts, and 20KHz pulse outputs, provide quick responses in demanding real-time applications. The S7-200 has over 200 instructions, including math, PID, For/Next loops, subroutines, sequence control, and more!

Integrated Communications

All S7-200 CPUs offer at least one RS485 communication port with speeds up to 187.5Kbaud. This not only provides fast access for programming and maintenance, but also allows you to build master/slave networks with up to 31 stations.

Using our Freeport capability can also connect non-S7-200 devices, such as bar code readers, intelligent machines, etc.. With Freeport, you can easily adapt the S7-200 CPU to virtually any serial ASCII protocol.

2.8 ADVANTAGES

2.8.1. Accuracy

In relay control systems logical knowledge's carries in electro-mechanical contactors, they can lose data because of mechanical errors. But PLC's are microprocessor-based system so logical data are carried inside the processor, so that PLC's are more accurate than relay type of controllers.

2.8.2. Data Areas

Data memory contains variable memory, and register, and output image register, internal memory bits, and special memory bits. This memory is accessed by a byte bit convention. For example to access bit 3 of variable memory byte 25 you would the address V25.3.

The following table shows the identifiers and ranges for each of the data area memory

types:

Area Identifier	Data Area	CPU 212	CPU 214
I	Input	I0.0 to I7.7	I0.0 to I7.7
Q	Output	Q0.0 to Q7.7	Q0.0 to Q7.7
M	Internal memory	M0.0 to M15.7	M0.0 to M31.7
SM	Special Memory	SM0.0 to SM45.7	SM0.0 to SM85.7
V	Variable Memory	V0.0 to V1023.7	V0.0 to V4095.7

2.8.3. Logic Control of Industrial Automation

Everyday examples of these systems are machines like dishwashers, clothes washers and dryers, and elevators. In these systems, the output tend to be 220 V AC power signals to motors, solenoids, and indicator lights, and the inputs are DC or AC signals from user interface switches, motion limit switches, binary liquid level sensor, etc. Another major function in these types of controllers is timing.

2.8.4. Data Object

The S7-200 has six kinds of devices with associated data: timers, counters, analogue inputs, analogue outputs, accumulators and high-speed counters. Each device has associated data. For example, the S7-200 has counters devices. Counters have a data value that maintains the current count value. There is an also a bit value, which is set when the current value is greater than or equal to the present value. Since there are multiple devices are numbered from 0 to n. The corresponding data objects and object bits are also numbered.

The following table shows the identifiers and ranges for each of the data object memory types:

Area Identifier	Data Area	CPU 212	CPU 214
T	Timers	T0 to T63	T0 to T127
C	Counters	C0 to C63	C0 to C127
AI	Analogue Input	AIW0 to AIW0	AIW0 to AIW30
AQ	Analogue Output	AQW0 to AQW30	AQW0 to AQW30
AC	Accumulator	AC0 to AC3	AC0 to AC3
HC	High-speed Counter	HC0	HC0 to HC2

2.8.5. Flexibility

When the control needs a change, relay type of controllers modification are hard, in PLC, this change can be made by PLC programmer equipment.

2.8.6. Communication

PLC's are computer-based systems. That's why, they can transfer their data to another PC, or they can take external inputs from another PC. With this specification we can control the system with our PC. With relays controlled system it's not possible.

CHAPTER THREE

3. PRACTICAL IMPLEMENTATION WITH PLC

3.1 OVERVIEW

The main aim of this chapter is to control the Lamp and also control of the Industrial AC motor with same PLC program. In this PLC program we will use these inputs and outputs and the steps of program will be given.

Table 3.1 Inputs, Outputs, Timers, and Counters that used in the Program

INPUTS	OUTPUTS	TIMERS	COUNTERS
I0.0: Starting the System	Q0.3: Operation of the Lamp	Timer On Delay: T 37 for 10 seconds ON and T38 for 20 seconds OFF	Count Up Counter: C0 for repeating the operation 5 times
I0.1: Reset button of the Counter		Timer On Delay CPU 212 T32 1ms T33-T36 10ms T37-T63 100 ms	Count Up Counter CPU 212 C0-C63

3.1.1 Explanation of the Networks that will be used in the operation

Network-1: When the I0.0 input will be activated at same time T38 and C0 will be closed because of this System will start and Q0.3 will be activated.

Network-2: Timer T38 is still OFF, I0.0 input that activated in Network-1 will active the Timer T37 for 10 seconds (we used T37 type of Timer so T37: 100ms Preset Value 100: $100 \times 100\text{ms} = 10 \text{ seconds}$). When T37 reached to the Preset Value it will active the Lamp will blow or AC motor will start to work.

Network-3: T37 activates T38 when it after 20 seconds (we used T38 type of Timer so T38: 100ms Preset Value 200: $200 \times 100\text{ms} = 20 \text{ seconds}$) later When T38 reached to the Preset Value it will stop the Lamp or AC Motor.

Network-4: In this Network Count Up Counter will enter to the system that we will use this counter as a C0; this counter will be activated by Q0.3 output that it will count 5 times means operation will be repeated 5 times.

Network-5: In the last network we must use END instruction this instruction will stop the program.

3.1.2. Statement List of the PLC Program

NETWORK 1

LD I0.0

A T37

AN T38

AN C0

= Q0.3

NETWORK 2

LD I0.0

AN T38

TON T37, +30

NETWORK 3

LD T37

TON T38, +100

NETWORK 4

LD Q0.3


LD I0.1

CTU C0, +5

NETWORK 5

MEND

3.1.3. Ladder Diagram of the PLC Program

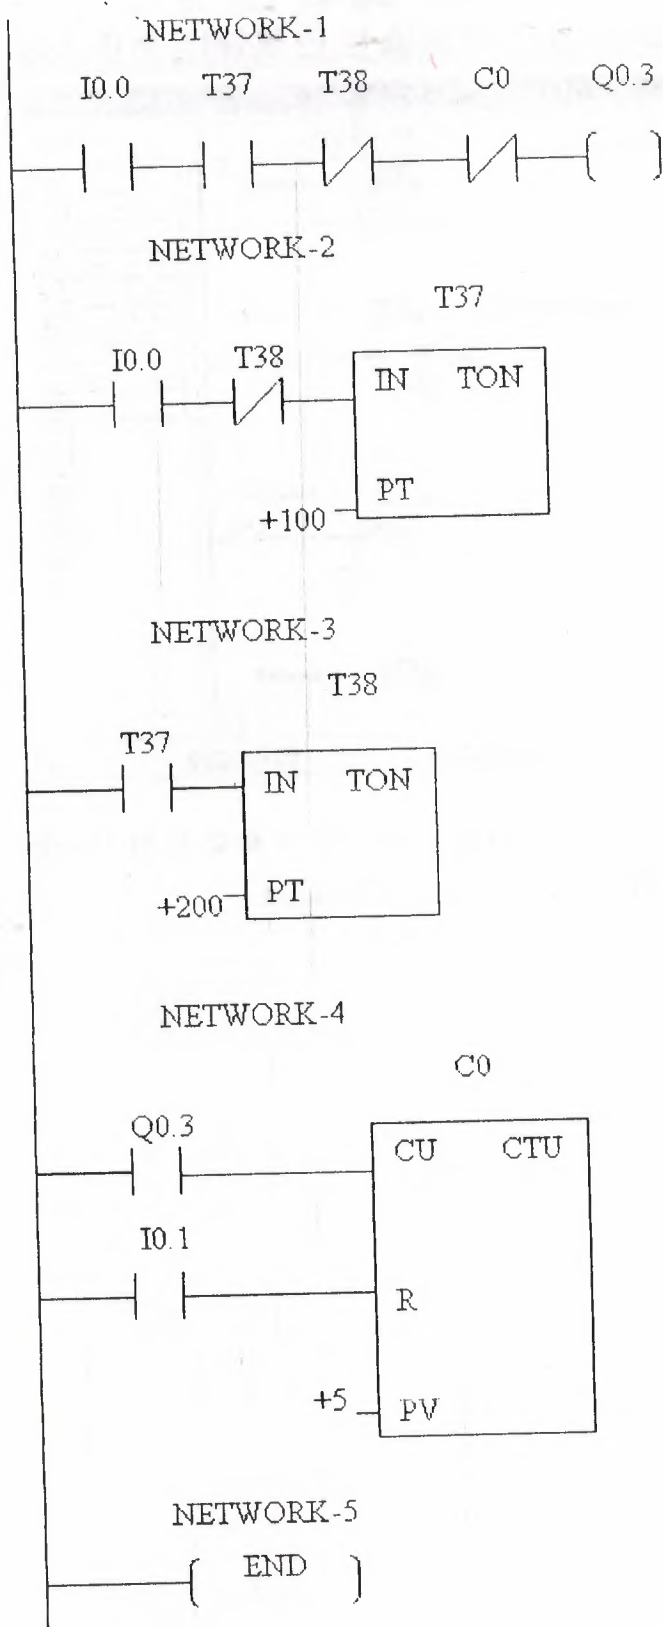

3.2. The View of SIMATIC S7-200 PLC Program

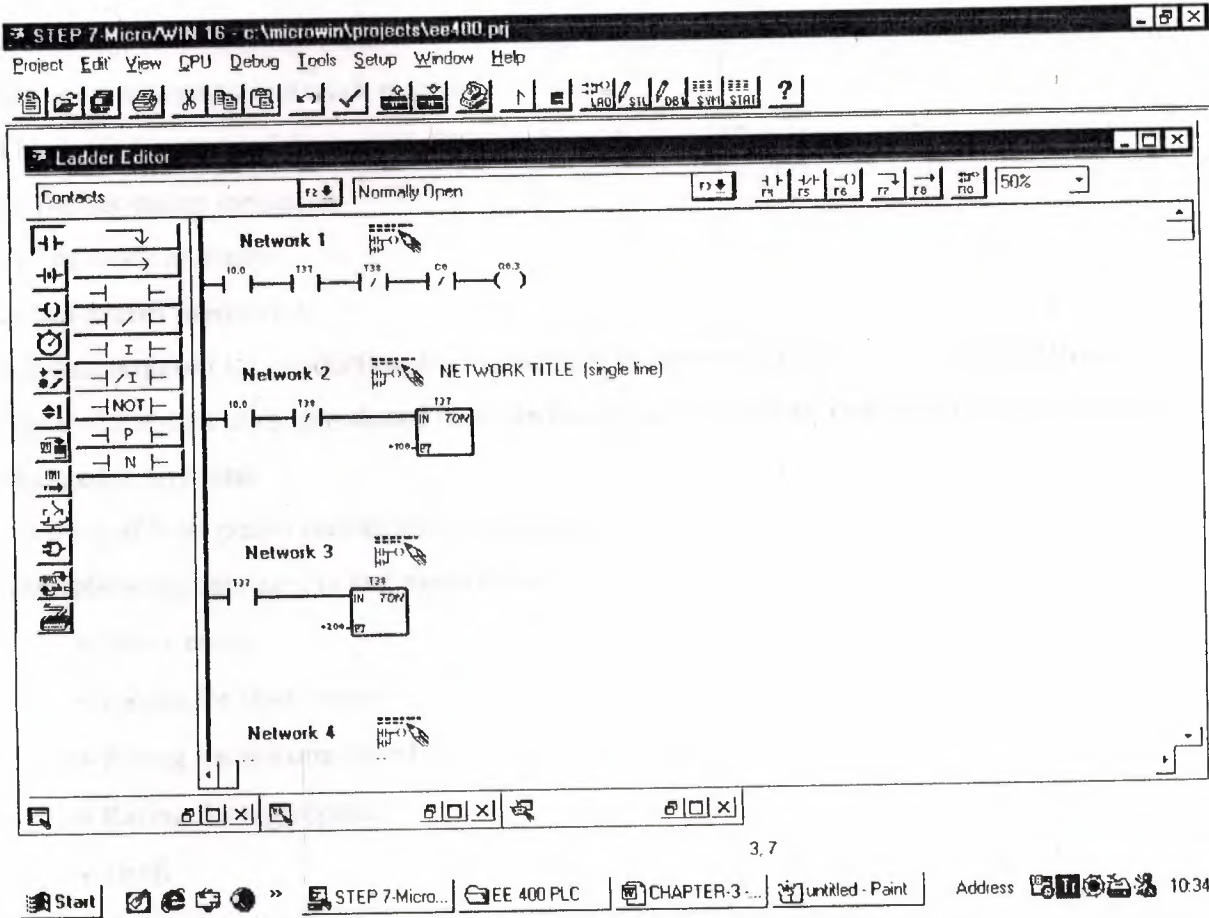


Figure 3.1. The View of SIMATIC S7-200 PLC Program

Chapter Four

4.1 Card

Set point memories and work memory.

The control system of the card dk 803 works with two different types of memories

a) The set points memories

b) The work memory

a) Set points memories

All data required for production are memorized in the so-called "set point" when being required the data once introduced thus can be called up again at time the data may also be changed at any time

A total of 9 set points memories are available.

The following data area in and memorized

- Silver count
- Rating for slow speed
- Rating for starting speed
- Rating for high speed
- Draft
- Fine balancing
- Delivery speeds
- Length of silver per can with pre-signal
- Pressure in the lower chute of the tuft feeder

DIRECTFEED DFK

- Setting of deflector blades for waste extraction
- Cylinder speed

When being required the complete data set of a selected set point memory will be copied in to the work memory

When the machine is switched off. A battery in the set point memories will not be last.

To obtain a general account of the contents of each set point memory it is advisable to fill in the ""data sheet for set points memories""

In the case of a battery failure all existing set points memories will be empty (contents erased) and all data must be fed in again.

b) Work memory

The production only takes place via the data of the work memory. For this purpose the data of the selected set points memory are transmitted (copied) in to the work memory.

The contents of the work memory can be changed without changing the contents of the selected set point memory.

The contents of the work memory may also be memorized in (copied into) one of the nine set point memories.


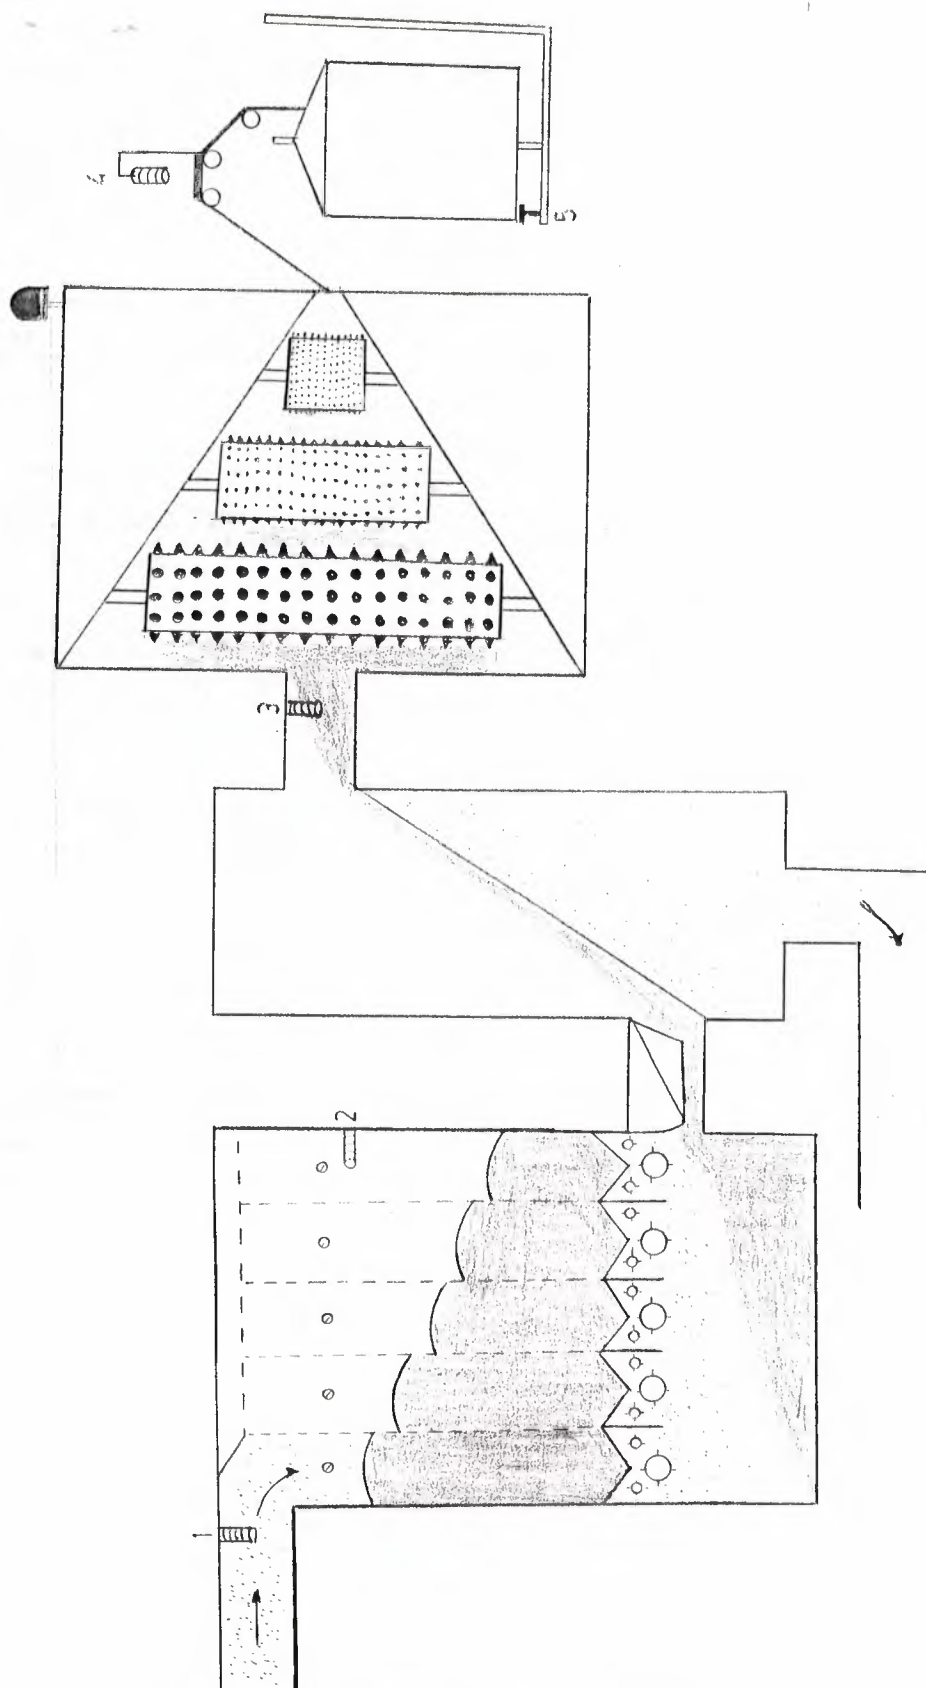


FIG 4.1 CARD MACHINE

4.1.1 Logic Program

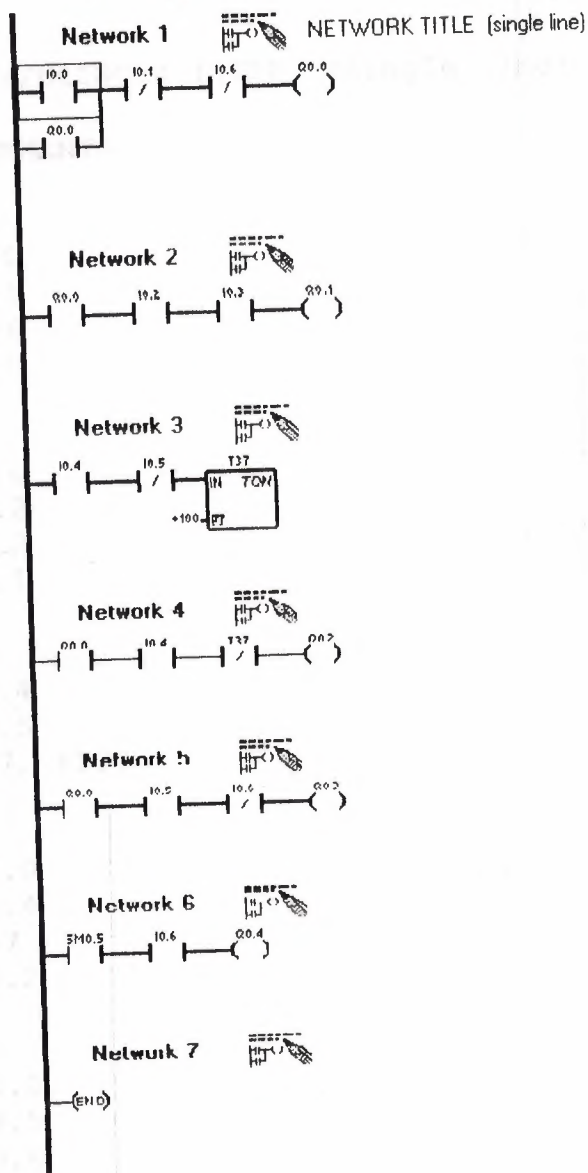

PROGRAM TITLE COMMENTS

Press F1 for help and example program

NETWORK 1 //NETWORK TITLE (single line)

NETWORK COMMENTS

```
LD      I0.0
O        Q0.0
AN       I0.1
AN       I0.6
=        Q0.0
```

NETWORK 2

```
LD      Q0.0
A        I0.2
A        I0.3
=        Q0.1
```

NETWORK 3

```
LD      I0.4
AN       I0.5
TON      T37, +100
```

NETWORK 4

```
LD      Q0.0
A        I0.4
AN       T37
=        Q0.2
```

NETWORK 5

```
LD      Q0.0
A        I0.5
AN       I0.6
=        Q0.3
```

NETWORK 6

```
LD      SM0.5
A        I0.6
=        Q0.4
```

NETWORK 7

MEND


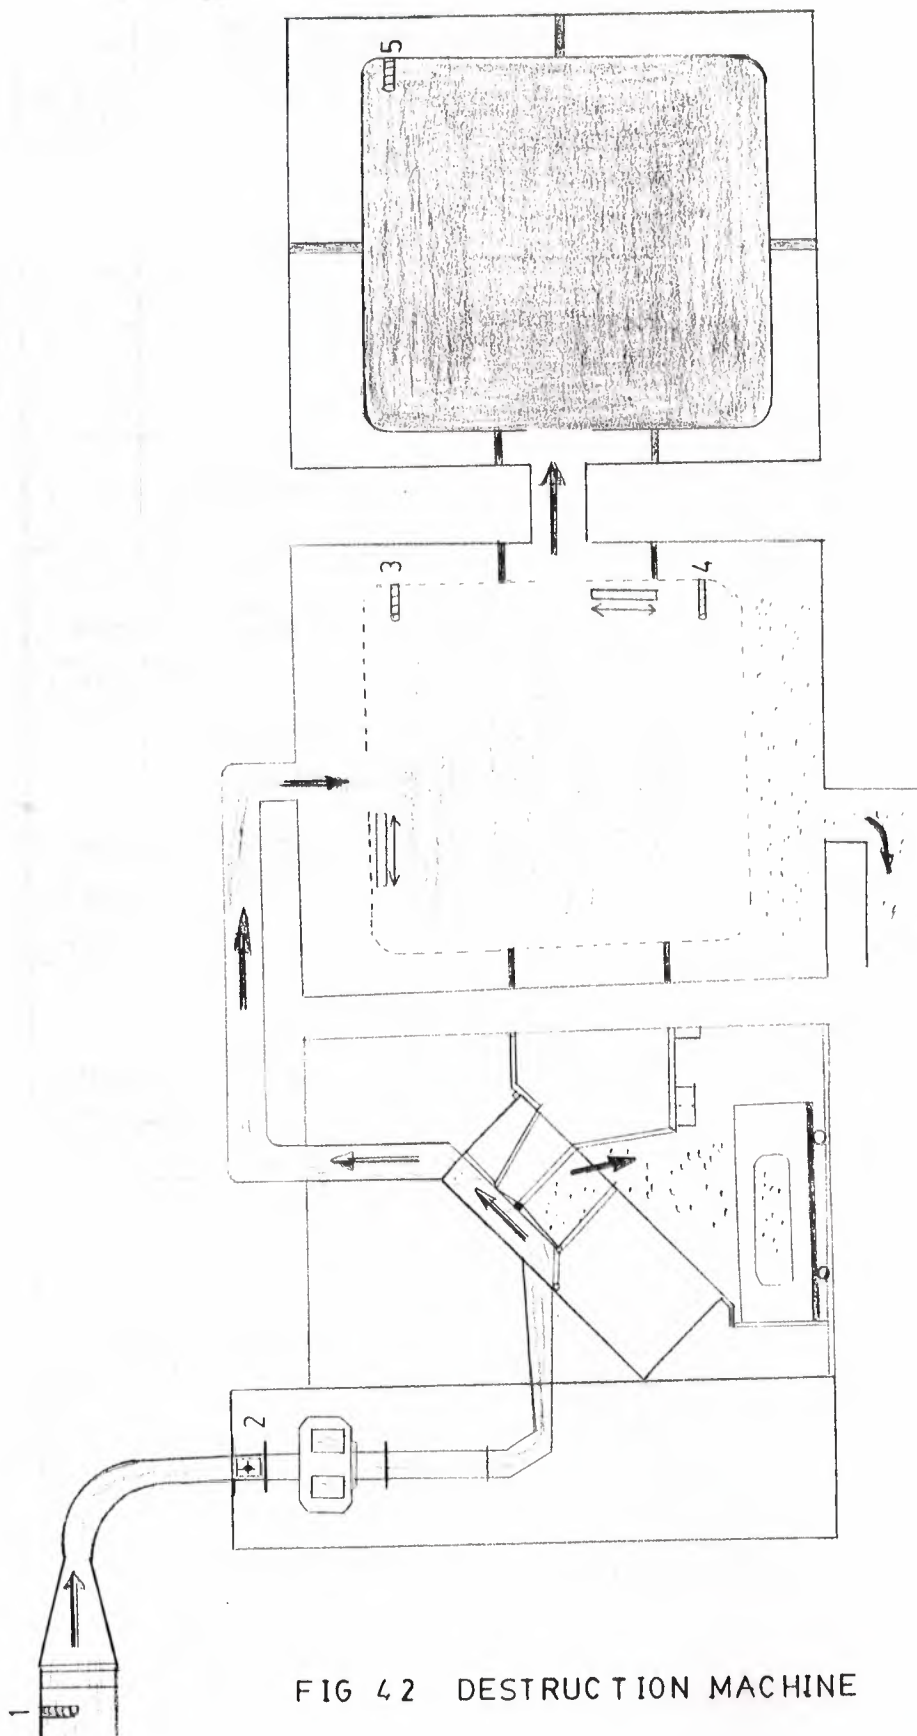


FIG 42 DESTRUCTION MACHINE

4.2.1 Logic Program

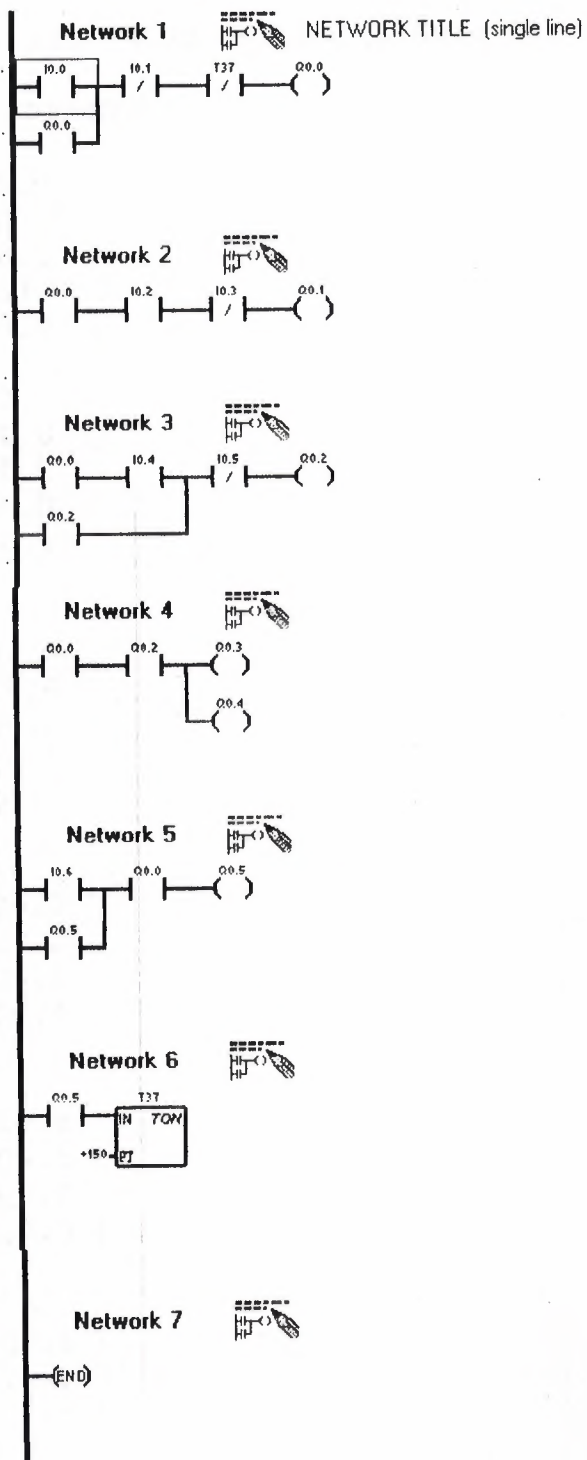

PROGRAM TITLE COMMENTS

Press F1 for help and example program

NETWORK 1 //NETWORK TITLE (single line)

NETWORK COMMENTS

```
LD      I0.0
O       Q0.0
AN      I0.1
AN      T37
=       Q0.0
```

NETWORK 2

```
LD      Q0.0
A       I0.2
AN      I0.3
=       Q0.1
```

NETWORK 3

```
LD      Q0.0
A       I0.4
O       Q0.2
AN      I0.5
=       Q0.2
```

NETWORK 4

```
LD      Q0.0
A       Q0.2
=       Q0.3
=       Q0.4
```

NETWORK 5

```
LD      I0.6
O       Q0.5
A       Q0.0
=       Q0.5
```

NETWORK 6

```
LD      Q0.5
TON     T37, +150
```

NETWORK 7

MEND

CONCLUSION

The S7-200 is summarized by the following properties:

- Easy entry
- Uncomplicated operation
- Peerless real-time characteristics
- Powerful communications capabilities

In the Laboratory conditions I carried out the operation that is possible. In this operation we controlled the Lamp for this first we connected PC to PLC after this operation our PLC has a 8 inputs, 6 outputs but I used 2 inputs as a I0.0 start button and I0.1 for Reset button of the counter, 1 output as a Q0.3 was the lamp output according to this informations I wrote a PLC program when I loaded the program to PLC at same time we connected the PLC outputs to the lamp circuit with about 220V then I pressed to start button and PLC program was operated.

Alternative of this operation we thought that it is possible to use same program like AC industrial Motor control but we had a one and important difference we could not work the AC motor with about 220V because of that we got about 115V AC from transformer and we carried out the same application. So we controlled both of them and we got successful results.

We can improve these operations by using the program that is comprehensively in Building Automation and Industrial Automations.

Over the world most of the new technologies are using by that investigate applications with PLC, we can say that advertisement panels, Building Automations, and Industrial Automations it can be given as an example to this application.

REFERENCES

- [1] SIMATIC S7-200 Programmable Controller, System Manual
- [2] Özgür Cemal Özerdem, Programmable Logic Controller and Programming, Near East University Press, Lefkoşa 2002.
- [3] <http://www.sea.siemens.com/controls/product/s7200/CNs7200.htm>
- [4] M.E.S A.Ş Yards Factory