

NEAR EAST UNIVERSITY

FACULTY OF ENGINEERING

Department of electrical and Electronic Engineering

**INTERNAL ELECTRICAL INSTALLATION
PROJECT**

Graduation Project

EE-400

Student: Mehmet Salih SANATÇI

NUMBER: 20000057

**Supervisor: Assist. Prof. Dr. Özgür Cemal
ÖZERDEM**

Lefkoşa -2007

ACKNOWLEDGEMENTS;

Studying in the Near East University Electrical and Engineering Department was one of the most difficult part of my study-life. Not only the difficulty of courses, but also my family life that I concern and military occupation that I am involved influenced my regular and constant study.

I grateful to Mr.Assistance Professor Dr. ÖZGÜR ÖZERDEM for preparing this project and Sharinghis experiences and knowledge with me.

I'm also grateful to all my lecturers especially Prof.Dr. Şenol BEKTAŞ and Prof.Dr.Fahrettin MAMEDOV then Dr.Kadri BÜRÜNCÜK and Özgür ÖZERDEM for their help and education they gave me.

I also thank to Mr. CEMAL KAVALCIOĞLU for his assistance.

Lastly, I owe a lot to my beloved wife for supporting me morally and my lovely daughters who I couldn't spend enough time.

ABSTRACT

Starting the electrical project drawings, architectural project and measurements were examined. The places main electrical household appliances (oven, refrigerator, washing machine, dish washer machine, air condition) were designated. The illumination calculations for rooms have been done and suitable luminaires have been selected. The lights and sockets power necessary have been determined. The cross - section of conductors have been chosen as well. The suitability of cross - section of chosen conductor has been controlled with voltage ^{drop} ~~decrease~~ calculation. The equal power distribution to phases has been provided by loading tables. The value of the service has been determined by cost analysis.

TABLE OF CONTENTS

ACKNOWLEDGEMENTS	1
ABSTRACT	2
CONTENTS	
INTRODUCTION	
General	7.
1. CHAPTER 1	
1.1. Area Exploring, Network Research	7
1.2. Historical Review of Wiring Installation	10
2. CHAPTER 2	13
Insulators	
2.1.1 Rubber	13
2.1.2 Polyvinyl chloride (PVC)	13
2.1.3 Paper	14
2.1.4 Glass	14
2.1.5 Mica	14
2.1.6 Ceramics	14
2.1.7 Bakelite	14
2.1.8 Insulation oil	14
2.1.9 Epoxide resin	15
2.1.10 Textiles	15
2.1.11 Gases	15
2.1.12 Liquid	15
3. CHAPTER	16
Generation and Transmission	
4. CHAPTER	17
Protection	
4.1 Reason for protection	17
4.1.2. Mechanical damage	17
4.1.3 Fire risk	18
4.1.4 Corrosion	18
4.1.5 Over Current	18

5.CHAPTER	
Earthing	23
5.1 Earthing Term	23
5.1.1 Earh	23
5.1.2 Earth Electrode	23
5.1.3 Earthing Lead	23
5.1.4 Earth Continuty Lead	23
5.2 Earth System	24
5.3 Important Point	30
5.4 Electric Shock	30
5.5 Earthing Testing	30
6.CHAPTER	31
6.1 Typs of Cable	36
6.2 Conducyor	41
7 CHAPTER 7	
Plastic Pipes	43
8. CHAPTERS	
Types of Intage Position	44
8.1. Over-Head Transmission Line	44
8.2. Under-Graund Intake	44
9. CHAPTER9	
Domestic Installation	45
9.1. General Ruis of Domestic	45
9.2 Pover Circuit	45
9.3 Ligthing Circuit	47
9.4 Types of Domestic Installation	47
9.4.1 Under Plasted	47
9.4.1.1 Celling Installation	47
9.4.1.2 Inside of home and	49
9.5 Choosing Cable Size	51
10 CHAPTER 10	
Special Installation	54
10.1 Dump Stuation	54
10.2 Corrasion	55

10.3 Sound Distrubution System	58
10.4 Personel Call System	58
10.5 Radio and Tv	60
10.6 Telephone System	60
11. CHAPTER	
Illumination	
11.1 Kinds of Lamp	62
11.2 Practical aspects of Lighting	65
11.3 Ambient Teprature of Lamp	65
11.4 The Effect of Votage Drop	67
11.5 Maintanence	67
11.6 Light Control	68
12 CHAPTER 12	
Example Project	
12.1 Area Exploring	69
12.2 Architecture Project	69
12.3 Illimination Calculation	71
12.4 Starting to Final Project Drawing	79
12.5 Voltage Drop and Chousing Cable	81
12.6 Cost Calculating	83
Conclussion	84
Refferences	85

CHAPTER 1: GENERALS

1.1 Historical Review of Installation Work

As one might expect to find in the early beginnings of any industry, the application, and the methods of application, of electricity for lighting, heating, and motive power was primitive in the extreme. Large-scale application of electrical energy was slow to develop. The first wide use of it was for lighting in houses, shops, and offices. By the 1870s, electric lighting had advanced from being a curiosity to something with a definite practical future. Arc lamps were the first form of lighting, particularly for the illumination of main streets. When the incandescent-filament lamp appeared on the scene electric lighting took on such a prominence that it severely threatened the use of gas for this purpose. But it was not until cheap and reliable metal-filament lamps were produced that electric lighting found a place in every home in the land. Even then, because of the low power of these early filament lamps, shop windows continued for some time to be lighted externally by arc lamps suspended from the fronts of buildings.

The earliest application of electrical energy as an agent for motive power in industry is still electricity's greatest contribution to industrial expansion. The year 1900 has been regarded as a time when industrialists awakened to the potential of the new form of power.

Electricity was first used in mining for pumping. In the iron and steel industry, by 1917, electric furnaces of both the arc and induction type were producing over 100,000 tons of ingot and castings. The first all-welded ship was constructed in 1920; and the other ship building processes were operated by electric motor power for punching, shearing, drilling machines and woodworking machinery.

The first electric motor drives in light industries were in the form of one motor-unit per line of shafting. Each motor was started once a day and continued to run throughout the whole working day in one direction at a constant speed. All the various machines driven from the shafting were started, stopped, reversed or changed in direction and speed by mechanical means. The development of integral electric drives, with provisions for starting, stopping and speed changes, led to the extensive use of the motor in small kilowatt ranges to drive an associated single machine, e.g. a lathe. One of the pioneers in the use of motors was the firm of Bruce Peebles, Edinburgh. The firm supplied, in the 1890s, a number of weatherproof, totally enclosed motors for quarries in Dumfries shire, believed to be among the first of their type in Britain. The first electric winder ever built in Britain was supplied in 1905 to a Lanark oil concern. Railway electrification started as long ago as 1883, but it was not until long after

the turn of this century that any major development took place.

The coverings for the insulation of wires in the early days included textiles and gutta-percha.

Progress in insulation provisions for cables was made when vulcanized rubber was introduced, and it is still used today.

Siemens Brothers made the first application of a lead sheath to rubber-insulated cables. The manner in which we name cables was also a product of Siemens, whose early system was to give a cable a certain length related to a standard resistance of 0.1 ohm. Thus a No.90 cable in their catalogue was a cable of which 90 yards had a resistance of 0.1 ohm. The Standard Wire Gauge also generally knew Cable sizes.

For many years ordinary VRI cables made up about 95 per cent of all installations. They were used first in wood casing, and then in conduit. Wood casing was a very early invention. It was introduced to separate conductors, this separation being considered a necessary safeguard against the two wires touching and so causing fire. Choosing a cable at the turn of the century was quite a task. From one catalogue alone, one could choose from fifty-eight sizes of wire, with no less than fourteen different grades of rubber insulation. The grades were described by such terms as light, high, medium, or best insulation. Nowadays there are two grades of insulation: up to 600 V and 600 V/1,000 V. And the sizes of cables have been reduced to a more practicable seventeen.

The main competitor to rubber as an insulating material appeared in the late 1930s. This material was PVC (polyvinyl chloride), a synthetic material that came from Germany. The material, though inferior to rubber so far as elastic properties were concerned, could withstand the effects of both oil and sunlight. During the Second World War PVC, used both as wire insulation and the protective sheath, became well established.

As experience increased with the use of TRS cables, it was made the basis of modified wiring systems. The first of these was the Calendar form-wiring system introduced in 1937. This was a tough rubber sheathed cable with a semi-embedded braiding treated with a green-colored compound. This system combined the properties of ordinary TRS and HSOS (house-service overhead system) cables.

So far as conductor material was concerned, copper was the most widely used. But aluminum was also applied as a conductor material. Aluminum, which has excellent electrical properties, has been produced on a large commercial scale since about 1890. Overhead lines of aluminum were first installed in 1898. Rubber-insulated aluminum cables of 3/0.036 inch and 3/0.045 inch were made to the order of the British Aluminum Company and used in the early years of this century for the wiring of the staff quarters at Kinlochleven in Argyllshire. Despite the fact

that lead and lead-alloy proved to be of great value in the sheathing of cables, aluminium was looked to for a sheath of, in particular, light weight. Many experiments were carried out before a reliable system of aluminium-sheathed cable could be put on the market.

Perhaps one of the most interesting systems of wiring to come into existence was the MICS (mineral-insulated copper-sheathed cable), which used compressed magnesium oxide as the insulation, and had a copper sheathed copper conductors. The cable was first developed in 1897 and was first produced in France. It has been made in Britain since 1937, first by Pyrotex Ltd, and later by other firms. Mineral insulation has also been used with conductors and sheathing of aluminium.

Non-ferrous conduits were also a feature of the wiring scene. Heavy-gauge copper tubes were used for the wiring of the Rayland's Library in Manchester in 1886. Aluminium conduit, though suggested during the 1920s, did not appear on the market until steel became a valuable material for munitions during the Second World War.

Insulated conduits also were used for many applications; in installation work, and are still used to meet some particular installation conditions. The 'Gilflex' system, for instance, makes use of a PVC tube, which can be bent cold, compared with earlier material, which required the use of heat for bending.

It was Thomas Edison who, in addition to pioneering the incandescent lamp, gave much thought to the provision of branch switches in circuit wiring. The term 'branch' meant a tee off from a main cable to feed small current-using items. The earliest switches were of the 'turn' type, in which the contacts were wiped together in a rotary motion to make the circuit. The first switches were really crude efforts: made of wood and with no positive ON or OFF position. Indeed, it was usual practice to make an inefficient contact to produce an arc to 'dim' the lights! Needless to say, this misuse of the early switches, in conjunction with their wooden construction, led to many fires. But new materials were brought forward for switch construction such as slate, marble, and, later, porcelain. Movements were also made more positive with definite ON and OFF positions. The 'turn' switch eventually gave way to the 'Tumbler' switch in popularity. It came into regular use about 1890. Where the name 'tumbler' originated is not clear; there are many sources, including the similarity of the switch action to the antics of Tumbler Pigeons. Many accessory names, which are household words to the electricians of today, appeared at the turn of the century: Verity's, McGeoch, Tucker, and Crabtree. Further developments to produce the semi-recessed, the flush, the ac only, and the 'silent' switch proceeded apace. The switches of today are indeed of long and worthy pedigrees.

It was one thing to produce a lamp operated from electricity. It was quite another thing to devise a way in which the lamp could be held securely while current was flowing in its circuit. The first lamps were fitted with wire tails for joining to terminal screws. It was Thomas Edison who introduced, in 1880, the screw cap, which still bears his name. It is said he got the idea from the stoppers fitted to kerosene cans of the time. Like many another really good idea, it superseded all its competitive lamp holders and its use extended through America and Europe. In Britain, however, it was not popular. The Edison & Swan Co. about 1886 introduced the bayonet-cap type of lamp-holder. The early type was soon improved to the lamp holders we know today.

Ceiling roses, too, have an interesting history; some of the first types incorporated fuses. The first rose for direct attachment to conduit came out in the early 1900s, introduced by Dorman & Smith Ltd.

One of the earliest accessories to have a cartridge fuse incorporated in it was the plug produced by Dorman & Smith Ltd. The fuse actually formed one of the pins, and could be screwed in or out when replacement was necessary. It is a rather long cry from those pioneering days to the present system of standard socket-outlets and plugs.

Early fuses consisted of lead wires; lead being used because of its low melting point.

It was not until the 1930s that the distribution of electricity in buildings by means of bus bars came into fashion, though the system had been used as far back as about 1880, particularly for street mains. In 1935 the English Electric Co. introduced a bus bar trunking system designed to meet the needs of the motorcar industry. It provided the overhead distribution of electricity into which system individual machines could be tapped wherever required; this idea caught on and designs were produced and put onto the market by Marryat & Place, GEC, and Ottermill.

The story of electric wiring, its systems, and accessories tells an important aspect in the history of industrial development and in the history of social progress. The inventiveness of the old electrical personalities, Compton, Swan, Edison, Kelvin and many others, is well worth noting; for it is from their brain-children that the present-day electrical contracting industry has evolved to become one of the most important sections of activity in electrical engineering. For those who are interested in details of the evolution and development of electric wiring systems and accessories, good reading can be found in the book by J. Mellanby: *The History of Electric Wiring* (MacDonald, London).

1.2 Historical Review of Wiring Installation

The history of the development of non-legal and statutory rules and regulations for the wiring of buildings is no less interesting than that of wiring systems and accessories. When electrical energy received a utilization impetus from the invention of the incandescent lamp, many set themselves up as electricians or electrical wiremen. Others were gas plumbers who indulged in the installation of electrics as a matter of normal course. This was all very well: the contracting industry had to get started in some way, however ragged. But with so many amateurs troubles were bound to multiply. And they did. It was not long before arc lamps, sparking commutators, and badly insulated conductors contributed to fires. It was the insurance companies, which gave their attention to the fire risk inherent in the electrical installations of the 1880s. Foremost among these was the Phoenix Assurance Co., whose engineer, Mr. Heaphy, was told to investigate the situation and draw up a report on his findings.

The result was the Phoenix Rules of 1882. These Rules were produced just a few months after those of the American Board of Fire Underwriters who are credited with the issue of the first wiring rules in the world.

The Phoenix Rules were, however, the better set and went through many editions before revision was thought necessary. That these Rules contributed to a better standard of wiring, and introduced a high factor of safety in the electrical wiring and equipment of buildings, was indicated by a report in 1892, which showed the high incidence of electrical fires in the USA and the comparative freedom from fires of electrical origin in Britain.

Three months after the issue of the Phoenix Rules for wiring in 1882, the Society of Telegraph Engineers and Electricians (now the Institution of Electrical Engineers) issued the first edition of Rules and Regulations for the Prevention of Fire Risks arising from Electric lighting. These rules were drawn up by a committee of eighteen men, which included some of the famous names of the day: Lord Kelvin, Siemens, and Crompton. The Rules, however, were subjected to some criticism. Compared with the Phoenix Rules they left much to be desired. But the Society was working on the basis of laying down a set of principles rather than, as Heaphy did, drawing up a guide or 'Code of Practice'. A second edition of the Society's Rules was issued in 1888. The third edition was issued in 1897 and entitled General

Rules recommended for Wiring for the Supply of Electrical Energy.

The Rules have since been revised at fairly regular intervals as new developments and the results of experience can be written in for the considered attention of all those concerned with the electrical equipment of buildings. Basically the regulations were intended to act as a guide for electricians and others to provide a degree of safety in the use of electricity by inexperienced persons such as householders. The regulations were, and still are, not legal; that is the law of the land cannot enforce them. Despite this apparent loophole, the regulations are accepted as a guide to the practice of installation work, which will ensure, at the very least, a minimum standard of work. The Institution of Electrical Engineers (IEE) was not alone in the insistence of good standards in electrical installation work. In 1905, the Electrical Trades Union, through the London District Committee, in a letter to the Phoenix Assurance Co., said '... they view with alarm the large extent to which bad work is now being carried out by electric light contractors . . . As the carrying out of bad work is attended by fires and other risks, besides injuring the Trade, they respectfully ask you to.. Uphold a higher standard of work'.

The legislation embodied in the Factory and Workshop Acts of 1901 and 1907 had a considerable influence on wiring practice. In the latter Act it was recognized for the first time that the generation, distribution and use of electricity in industrial premises could be dangerous. To control electricity in factories and other premises a draft set of Regulations was later to be incorporated into statutory requirements.

While the IEE and the statutory regulations were making their positions stronger, the British Standards Institution brought out, and is still issuing, Codes of Practice to provide what are regarded as guides to good practice. The position of the Statutory Regulations in this country is that they form the primary requirements, which must by law be satisfied. The IEE Regulations and Codes of Practice indicate supplementary requirements. However, it is accepted that if an installation is carried out in accordance with the IEE Wiring Regulations, it generally fulfils the requirements of the Electricity Supply Regulations. This means that a supply authority can insist upon all electrical work to be carried out to the standard of the IEE Regulations, but cannot insist on a standard which is in excess of the IEE requirements.

CHAPTER 2:

INSULATORS

An insulator is defined as a material, which offers an extremely high resistance to the passage of an electric current. Were it not for this property of some materials we would not be able to apply electrical energy to so many uses today. Some materials are better insulators than others. The resistivity of all insulating materials decreases with an increase in temperature. Because of this, a limit in the rise in temperature is imposed in the applications of insulating materials, otherwise the insulation would break down to cause a short circuit or leakage current to earth. The materials used for insulation purposes in electrical work are extremely varied and are of a most diverse nature. Because no single insulating material can be used extensively, different materials are combined to give the required properties of mechanical strength, adaptability, and reliability. Solids, liquids, and gases are to be found used as insulation.

Insulating materials are grouped into classes:

Class A - Cotton, silk, paper, and similar organic materials; impregnated or immersed in oil.

Class B - Mica, asbestos, and similar inorganic materials, generally found in a built-up form combined with cement binding cement. Also polyester enamel covering and glass-cloth and micanite.

Class C - Mica, porcelain glass quartz: and similar materials.

Class E - Polyvinyl acetal resin. Class H - Silicon-glass.

The following are some brief descriptions of some of the insulating materials more commonly found in electrical work.

2.1.1. Rubber

Used mainly for cable insulation: Catnôfhe used for high temperatures as it hardens.

Generally used with sulphur (vulcanization) and china clay. Has high insulation-resistance value.

2.1.2. Polyvinyl chloride (PVC)

This is a plastics material, which will tend to flow when used in high temperatures. Has a

lower insulation-resistance value than rubber. Used for cable insulation and sheathing against mechanical damage.

2.1.3. Paper

Must be used in an impregnated form (resin or oil). Used for cable insulation. Impregnated with paraffin wax, paper is used for making capacitors. Different types are available: Kraft, cotton, tissue, and pressboard.

2.1.4. Glass

Used for insulators (overhead lines). In glass fiber form it is used for cable insulation where high temperatures are present, or where areas are designated 'hazardous'. Requires a suitable impregnation (with silicone varnish) to fill the spaces between the glass fibers.

2.1.5. Mica

This material is used between the segments of commutators of dc machines, and under slip rings of ac machines. Used where high temperatures are involved such as the heating elements of electric irons. It is a mineral, which is present in most granite-rock formations; generally produced in sheet and block form. Micanite is the name given to the large sheets built up from small mica splitting and can be found backed with paper, cotton fabric, silk or glass-cloth or varnishes. Forms include tubes and washers.

2.1.6. Ceramics

Used for overhead-line insulators and switchgear and transformer bushings as lead-ins for cables and conductors. Also found as switch-bases, and insulating beads for high-temperature insulation applications.

2.1.7. Bakelite

A very common synthetic material found in many aspects of electrical work (e.g. lamp holders, junction boxes), and used as a construction material for enclosing switches to be used with insulated wiring systems.

2.1.8. Insulating oil

This is a mineral oil used in transformers, and in oil-filled circuit breakers where the arc

drawn out when the contacts separate, is quenched by the oil. It is used to impregnate wood, paper, and pressboard. This oil breaks down when moisture is present.

2.1.9. Epoxide resin

This material is used extensively for 'potting' or encapsulating electronic items. In larger castings it is found as insulating bushings for switchgear and transformers.

2.1.10. Textiles

This group of insulating materials includes both natural (silk, cotton, and jute) and synthetic (nylon, Terylene). They are often found in tape form, for winding-wire coil insulation.

2.1.11. Gases

Air is the most important gas used for insulating purposes. Under certain conditions (humidity and dampness) it will break down. Nitrogen and hydrogen are used in electrical transformers and machines as both insulates and coolants.

2.1.12. Liquids

Mineral oil is the most common insulant in liquid form. Others include carbon tetrachloride, silicone fluids and varnishes. Semi-liquid materials include waxes, bitumens and some synthetic resins. Carbon tetrachloride is found as an arc-quencher in high-voltage cartridge type fuses on overhead lines. Silicone fluids are used in transformers and as dashpot damping liquids. Varnishes are used for thin insulation covering for winding wires in electromagnets. Waxes are generally used for impregnating capacitors and fibres where the operating temperatures are not high. Bitumens are used for filling cable-boxes; some are used in a paint form. Resins of a synthetic nature form the basis of the materials known as 'plastics' (polyethylene, polyvinyl chloride, melamine and polystyrene). Natural resins are used in varnishes, and as bonding media for mica and paper sheets hot-pressed to make boards.

CHAPTER 3:

GENERATION AND TRANSMISSION

The generation of electric is to convert the mechanical energy into the electrical energy. Mechanical energy means that motors which makes the turbine turn.

Electrical energy must be at definite value. And also frequency must be 50Hz or at other countries 60Hz. The voltage which is generated (the output of the generator) is 11KV. After the station the lines which transfer the generated voltage to the customers at expected value. These can be done in some rules. If the voltage transfers as it is generated up to customers. There will be voltage drop and loss. So, voltage is stepped up. When the voltage is stepped up, current will decrease. That is why the voltage is increased. This is done as it is depending on ohm's law. Actually these mean low current. Used cables will become thin. This will be economic and it will be easy to install transmission lines. If we cannot do this, we will have to use thicker cable.

To transfer the generated voltage these steps will be done. Generated voltage (11KV) is applied to the step-up transformer to have 66KV voltage is carried up to a sub-station. In this sub-station the voltage will be stepped-down again to 11KV. At the end the voltage stepped-down to 415V that is used by customers. As a result the value of the voltage has to be a definite value. These;

- 1- line to line - 415V
- 2- line to neutral - 240V
- 3- line to earth - 240V
- 4- earth to neutral - 0V

CHAPTER 4:

PROTECTION

The meaning of the word protection, as used in electrical industry, is not different to that in every day used. People protect themselves against personal or financial loss by means of insurance and from injury or discomfort by the use of the correct protective clothing. They further protect their property by the installation of security measures such as locks and for alarm systems.

In the same way electrical systems need to be protected against mechanical damage, the effect of the environment, and electrical over current to be installed in such a fashion that persons and live stock are protected from the dangers that such an electrical installation may create.

4.1. REASONS FOR PROTECTIONS

4.1.2. Mechanical Damage

Mechanical damage is the term used to describe the physical harm sustained by various parts of electrical sets. Generally by impact hitting cable with a hammer by abrading. Cables sheath being rubbed against wall corner or by collision (e.g. sharp object falling to cut a cable prevent damage of cable sheath conduits, ducts, trunking and casing)

4.1.3. Fire Risk:

Electrical fire caused by;

- a-) A fault defect all missing in the wiring
- b-) Faults or defects in appliances
- c-) Mal-operation or abuse the electrical circuit (e.g. overloading)

4.1.4. Corrosion:

Wherever metal is used there is often the attendant problem of corrosion and it's prevented. There is two necessary corrosion for corrosion.

- a-) The prevention of contact between two dissimilar metals ex copper & aluminium.
- b-) Prohibition of soldering fluxes which remains acidic or corrosive at the completion of a soldering operation ex cable joint together.

- c-)The protection metal sheaths of cables and metal conduction fittings where they come into contact with lime, cement or plaster and certain hard woods ex: corrosion of the metal boxes.
- d-)Protection of cables wiring systems and equipment's against the corrosive action of water, oil or dampness if not they are suitable designed to with these conditions.

4.1.5. Over current

Over current, excess current the result of either an overload or a short circuit. The overloading occurs when an extra load is taken from the supply. This load being connected in parallel with the existing load in a circuit decreases the overload resistance of the circuit and current increases which causes the cables and deteriorate the cable insulation. And the short-circuit. Short circuit is a direct contact between live conductors

- a-)Neutral conductor. (Fuse)
- b-)Earthed metal work (Operators)

Protectors of overcurrent

- a-)Fuses
- b-)Circuit Breakers

1. Fuse

A device for opening a circuit by means of a conductor designed to melt when an excessive current flows along it .

There are three types of fuses.

- a-)Rewireable
- b-)Cartridge
- c-)HBC (High Breaking Capacity)

a-) Rewireable Fuse:

A rewireable fuse consists of a fuse/holder, a fuse element and a fuse carrier. The holder and carrier are being made porcelain or bakelite. These fuses have designed with color codes, which are marked on the fuse holder-as-follows;

Table.I Fuse current rating and color codes

Current Rating	Color Codes
5A	White
10A	Blue
20A	Yellow
30A	Red
45A	Green
60A	Purple

But, this type of fuse has disadvantages. Putting wrong fuse element can be damaged and spark so fire risk, can open circuit at starting-current surges.

b-)Cartridge Fuse

A cartridge fuse consists of a porcelain tube with metal and caps to which the element is attached. The tube is filled silica. They have the advantage, over the rewirable fuse of not deteriorating, of accuracy in breaking at rated values and of not arcing when interrupting faults. They are however, expensive to replace.

c-)High –Breaking Capacity (HBC)

It is a sophisticated variation of the cartridge fuse and is normally found protecting motor circuits and industrial installations. Porcelain body filled with silica with a silver element and lug type and caps. It is very fast acting and can discriminate between a starting surge and an overload.

II. Circuit-breakers

The circuit breakers can be regarded as a switch, which can be opened automatically by means of a 'tripping' device. It is, however, more than this

Whereas a switch is capable of making and breaking a current not greatly in excess of its rated normal current, the circuit-breaker can make and break a circuit, particularly in abnormal conditions such as the occasion of a short-circuit in an installation. It thus disconnects automatically a faulty circuit.

A circuit breaker is selected for a particular duty, taking into consideration the following. (a) the normal current it will have to carry and (b) the amount of current which the supply will feed into the circuit fault, which current the circuit-breaker will have to interrupt without damage to itself.

The circuit breaker generally has a mechanism which, when in the closed position, holds the contacts together. The contacts are separated when the release mechanism of the circuit breaker is operated by hand or automatically by magnetic means. The circuit breaker with magnetic 'tripping' (the term used to indicate the opening of the device) employs a solenoid, which is an air-cooled coil. One end of the coil is located in an iron cylinder attached to a trip mechanism consisting of a series of pivoted links. When the circuit breaker is closed, the main current passes through the links. When the current rises above a certain value (due to an overload or a fault), the cylinder moves within the solenoid to cause the attached linkage to collapse and, in turn, separate the circuit-breaker contacts.

Circuit breakers are used in many places in place of fuses because of a number of definite advantages. First, in the case of an overload or fault all poles of the circuit are positively disconnected. The circuit breaker is also capable of remote control by push buttons, by under-voltage release coils, or by magnetic trip coils. The over-current setting of the circuit breakers can be adjusted to suit the load conditions of the circuit to be controlled. Time-lag devices can also be introduced so that the time taken for tripping can be delayed because, in some instances, a fault can clear itself, and so avoid the need for a circuit breaker to disconnect not only the faulty circuit but also other healthy circuits, which may be associated with it. The time-lag is also useful in motor circuits, to allow the circuit-breaker to stay closed while the motor takes its high initial starting current during the run-up to attain its normal speed. After tripping, circuit breakers can be closed immediately without loss of time. Circuit-breaker contacts separate either in air or in insulating oil.

In certain circumstances, circuit breakers may be used with 'back-up' protection, which involves the provision of HRC (high breaking capacity) fuses in the main circuit-breaker circuit. In this instance, an extremely heavy over current, such as is caused by a short circuit, is handled by the fuses, to leave the circuit breaker to deal with the over currents caused by overloads.

An increasing use for modern electrical installations is the miniature circuit-breaker (MCB). It is used as an alternative to the fuse, and has certain advantages: it can be reset or reclosed easily; it gives a close degree of small over current protection (the tripping factor is 1.1); it will trip on a small sustained over current, but not on a harmless transient over current such as

as switching surge. For all applications the MCB tends to give much better overall protection against both fire and shock risks than can be obtained with the use of normal HBC or rewirable fuses. Miniature circuit breakers are available in distribution-board units for final circuit protection.

One main disadvantage of the MCB is the initial cost, although it has the long-term advantage. There is also tendency for the tripping mechanism to stick or become sluggish in operation after long periods of inaction. It is recommended that the MCB be tripped at frequent intervals to 'ease the springs' and so ensure that it performs its prescribed duty with no damage either to itself or to the circuit it protects.

Values of fuses;

6A, 10A, 16A, 32A, 45A, 60A,, 100A.

4.6. Earth Leakages:

Protection for Earth Leakages:

Using ELCB, which stands for Earth Leakage Circuit Breaker, does this type of protection. There are two types of earth leakage circuit breaker.

1. Current Operated ELCB (C/O ELCB)

Current flowing through the live conductor and back through the neutral conductor and there will be opposite magnetic area in the iron ring, so that the trip coils does not operate. If a live to earth fault or a neutral to earth fault happens the incoming and returning current will not be same and magnetic field will circulate in the iron ring to operate the trip coil. This type of operators is used in today.

The following are some of the points, which the inspecting electrician should look for:

- 1) Flexible cables not secure at plugs.
- 2) Frayed cables.
- 3) Cables without mechanical protection.
- 4) Use of unearthed metalwork.
- 5) Circuits over-fused.
- 6) Poor or broken earth connections, and especially sign of corrosion.
- 7) Unguarded elements of the radiant fires.
- 8) Unauthorized additions to final circuits resulting in overloaded circuit cables.

- 9) Unprotected or unearthed socket-outlets.
- 10) Appliances with earthing requirements being supplied from two-pin BC adaptors.
- 11) Bell-wire used to carry mains voltages.
- 12) Use of portable heating appliances in bathrooms.
- 13) Broken connectors, such as plugs.
- 14) Signs of heating at socket-outlet contacts.

The following are the requirements for electrical safety:

- 1) Ensuring that all conductors are sufficient in csa for the design load current of circuits.
- 2) All equipment, wiring systems, and accessories must be appropriate to the working conditions.
- 3) All circuits are protected against over current using devices, which have ratings appropriate to the current-carrying capacity of the conductors
- 4) All exposed conductive parts are connected together by means of CPCs.
- 5) All extraneous conductive parts are bonded together by means of main bonding conductors and supplementary bonding conductors are taken to the installation main earth terminal.
- 6) All control and over current protective devices are installed in the phase conductor.
- 7) All electrical equipment has the means for their control and isolation.
- 8) All joints and connections must be mechanically secure and electrically continuous and be accessible at all times.
- 9) No additions to existing installations should be made unless the existing conductors are sufficient in size to carry the extra loading.
- 10) All electrical conductors have to be installed with adequate protection against physical damage and be suitably insulated for the circuit voltage at which they are to operate.
- 11) In situations where a fault current to earth is not sufficient to operate an over current device, an RCD must be installed.
- 12) All electrical equipment intended for use outside equipotential zone must be fed from socket-outlets incorporating an RCD.
- 13) The detailed inspection and testing of installation before they are connected to a mains supply, and at regular intervals thereafter.

CHAPTER 5:

EARTHING

An efficient earthing arrangement is an essential part of every electrical installation and system to guard against the effects of leakage currents, short-circuits, static charges and lightning discharges. The basic reason for earthing is to prevent or minimize the risk of shock to human beings and livestock, and to reduce the risk of fire hazard. The earthing arrangement provides a low-resistance discharge path for currents, which would otherwise prove injurious or fatal to any person touching the metalwork associated with the faulty circuit. The prevention of electric shock risk in installation is a matter, which has been given close attention in these past few years, particularly since the rapid increase in the use of electricity for an ever-widening range of applications.

5.1. EARTHING TERMS

5.1.1 Earth:

A connection to the general mass of earth by means of an earth electrode.

5.1.2 Earth Electrode:

A metal plate, rod or other conductor band or driven in to the ground and used for earthing metal work.

5.1.3 Earthing Lead:

The final conductor by means of which the connection to the earth electrode is made.

5.1.4 Earth Continuity Conductor (ECC):

The conductor including any lam connecting to the earth or each other those part of an installation which are required to be earthed. The ECC may be in whole or part the metal conduit or the metal sheath of cables or the special continuity conductor of a cable or flexible cord incorporating such a conductor.

5.2 Earthing Systems:

In our electricity system, which is same to UK electricity, is an earthed system, which means that star or neutral point of the secondary side of distribution transformer is connected to the general mass of earth.

In this way, the star point is maintained at or about 0V. Unfortunately, this also means that persons or livestock in contact with a live part and earth is at risk of electric shock.

Lightning protection

Lightning discharges can generate large amounts of heat and release considerable mechanical forces, both due to the large currents involved. The recommendations for the protection of structures against lightning are contained in BS Code of Practice 6651 (Protection of Structures Against Lightning). The object of such a protective system is to lead away the very high transient values of voltage and current into the earth where they are safely dissipated. Thus a protective system, to be effective, should be solid and permanent. Two main factors are considered in determining whether a structure should be given protection against lightning discharges:

1. Whether it is located in an area where lightning is prevalent and whether, because of its height and/or its exposed position, it is most likely to be struck.
2. Whether it is one to which damage is likely to be serious by virtue of its use, contents, importance, or interest (e.g. explosives factory, church monument, railway station, spire, radio mast, wire fence, etc.).

It is explained in BS Code of Practice 6651 that the 'zone of protection' of a single vertical conductor fixed to a structure is considered to be a cone with an apex at the highest point of the conductor and a base of radius equal to the height. This means that a conductor 30 meters high will protect that part of the structure which comes within a cone extending to 60 meters in diameter at ground level. Care is therefore necessary in ensuring that the whole of a structure or building falls within the protective zone; if it does not, two down conductors must be run to provide two protective zones within which the whole structure is contained. All metallic objects and projections, such as metallic vent pipes and guttering, should be bonded to form part of the air-termination network. All down conductors should be cross-bonded. The use of multiple electrodes is common. Rule 5 of the Phoenix Fire Office Rules states:

Earth connections and number. The earth connection should be made either by means of a copper plate buried in damp earth, or by means of the tubular earth system, or by connection to the water mains (not nowadays recommended). The number of connections should be in proportion to the ground area of the building, and there are few structures where less than two are necessary ... Church spires, high towers, factory chimneys having two down conductors should have two earths which may be interconnected.

All the component parts of a lightning-protective system should be either castings of leaded gunmetal, copper, naval brass or wrought phosphor bronze, or sheet copper or phosphor bronze. Steel, suitably protected from corrosion, may be used in special cases where tensile or compressive strength is needed.

Air terminations constitute that part of the system, which distributes discharges into, or collects discharges from, the atmosphere. Roof conductors are generally of soft annealed copper strip and interconnect the various air terminations. Down conductors, between earth and the air terminations, are also of soft-annealed copper strip. Test points are joints in down conductors, bonds, earth leads, which allow resistance tests to be made. The earth terminations are those parts of the system designed to collect discharges from, or distribute charges into, the general mass of earth. Down conductors are secured to the face of the structure by 'holdfasts' made from gunmetal. The 'building-in' type is used for new structures; a caulking type is used for existing structures.

With a lightning protection system, the resistance to earth need not be less than 10 ohms. But in the case of important buildings, seven ohms is the maximum resistance. Because the effectiveness of a lightning conductor is dependent on its connection with moist earth, a poor earth connection may render the whole system useless. The 'Hedges' patent tubular earth provides a permanent and efficient earth connection, which is inexpensive, simple in construction and easy to install. These earths, when driven firmly into the soil, do not lose their efficiency by changes in the soil due to drainage; they have a constant resistance by reason of their being kept in contact with moist soil by watering arrangements provided at ground level. In addition, tubular or rod earths are easier to install than plate earths, because the latter require excavation.

Lightning conductors should have as few joints as possible. If these are necessary, other than at the testing-clamp or the earth-electrode clamping points, flat tape should be tinned, soldered, and riveted; rod should be screw-jointed.

All lightning protective systems should be examined and tested by a competent engineer after

completion, alteration, and extension. A routine inspection and test should be made once a year and any defects remedied. In the case of a structure containing explosives or other inflammable materials, the inspection and test should be made every six months. The tests should include the resistance to earth and earth continuity. The methods of testing are similar to those described in the IEE Regulations, though tests for earth-resistance of earth electrodes require definite distances to be observed.

Anti-static earthing

'Static', which is a shortened term for 'static electric discharge' has been the subject of increasing concern in recent years partly due to the increasing use of highly insulating materials (various plastics and textile fibres).

Earthing practice

1. Direct Earthing

The term 'direct earthing' means connection to an earth electrode, of some recognized type, and reliance on the effectiveness of over current protective devices for protection against shock and fire hazards in the event of an earth fault. If direct earthing protects non-current-carrying metalwork, under fault conditions a potential difference will exist between the metalwork and the general mass of earth to which the earth electrode is connected. This potential will persist until the protective device comes into operation. The value of this potential difference depends on the line voltage, the substation or supply transformer earth resistance, the line resistance, the fault resistance, and finally, the earth resistance at the installation. Direct earth connections are made with electrodes in the soil at the consumer's premises. A further method of earthing connection to earth is that which makes use of the metallic sheaths of underground cables. But such sheaths are more generally used to provide a direct metallic connection for the return of earth-fault current to the neutral of the supply system rather than as a means of direct connection to earth.

The earth electrode, the means by which a connection with the general mass of earth is made, can take a number of forms, and can appear either as a single connection or as a network of multiple electrodes. Each type of electrode has its own advantages and disadvantages.

The design of an earth electrode system takes into consideration its resistance to ensure that this is of such a value that sufficient current will pass to earth to operate the protective system. It must also be designed to accommodate thermally the maximum fault current during the

time it takes for the protective device to clear the fault. In designing for a specific ohmic resistance, the resistivity of the soil is perhaps the most important factor, although it is a variable one.

The current rating or fault-current capacity of earth electrodes must be adequate for the 'fault-current/time-delay' characteristic of the system under the worst possible conditions. Undue heating of the electrode, which would dry out the adjacent soil and increase the earth resistance, must be avoided. Calculated short-time ratings for earth electrodes of various types are available from electrode manufacturers; these ratings are based on the short-time current rating of the associated protective devices and a maximum temperature, which will not cause damage to the earth connections or to the equipment with which they may be in contact. In general soils have a negative temperature coefficient of resistance. Sustained current loadings result in an initial decrease in electrode resistance and a consequent rise in the earth-fault current for a given applied voltage. However, as the moisture in the soil is driven away from the soil/electrode interface, the resistance rises rapidly and will ultimately approach infinity if the temperature rise is sufficient. This occurs in the region of 100°C and results in the complete failure of the electrode.

The current density of the electrode is found by:

$$\text{Current density} = \frac{I}{A \sqrt{t}} = \frac{92 \times 10^3}{A \sqrt{t}}$$

where I = short-circuit fault current; A = area (in cm^2); t = time in seconds (duration of the fault current).

The formula assumes a temperature rise of 120°C, over an ambient temperature of 25°C, and the use of high-conductivity copper. The formula does not allow for any dissipation of heat into the ground or into the air.

Under fault conditions, the earth electrode is raised to a potential with respect to the earth surrounding it. This can be calculated from the prospective fault current and the earth resistance of the electrode. It results in the existence of voltages in soil around the electrode, which may harm telephone and pilot cables (whose cores are substantially at earth potential) owing to the voltage to which the sheaths of such cables are raised. The voltage gradient at the surface of the ground may also constitute a danger to life, especially where cattle and livestock are concerned. In rural areas, for instance, it is not uncommon for the earth-path resistance to be such that faults are not cleared within a short period of time and animals which congregate near the areas in which current carrying electrodes are installed are liable to

receive fatal shocks. The same trouble occurs on farms where earth electrodes are sometimes used for individual appliances. The maximum voltage gradient over a span of 2 meters to a 25 mm diameter pipe electrode is reduced from 85 per cent of the total electrode potential when the top of the electrode is at ground level to 20 per cent and 5 per cent when the electrode is buried at 30 cm and 100 cm respectively. Thus, in areas where livestock are allowed to roam it is recommended that electrodes be buried with their tops well below the surface of the soil. Corrosion of electrodes due to oxidation and direct chemical attack is sometimes a problem to be considered. Bare copper acquires a protective oxide film under normal atmospheric conditions which does not result in any progressive wasting away of the metal. It does, however, tend to increase the resistance of joints at contact surfaces. It is thus important to ensure that all contact surfaces in copper or galvanized steel at test links, be carefully prepared so that good electrical connections can be made. Electrodes should be bolted up tightly. Electrodes should not be installed in ground contaminated by corrosive chemicals. If copper conductors must be run in ground containing hydrogen sulphide, or laid in ground liable to contamination by corrosive chemicals they should be protected by a covering of PVC adhesive tape or a wrapping of suitable material, up to the point of connection with the earth electrode. Electrolytic corrosion will occur in addition to the other forms of attack if dissimilar metals are exposed to the action of moisture. Bolts and rivets used for making connections in copper should be of either brass or copper. Anultracopper should not be in direct contact with ferrous metals. Contact between bare copper and the lead sheath of a cable should be avoided, especially underground. If it is impossible to make the connection of dissimilar metals, these should be protected by painting with a moisture-resistant bituminous paint or compound, or by wrapping with PVC tape, to exclude moisture.

The following are the types of electrodes used to make contact with the general mass of earth:

Plates. These are generally made from copper, zinc, steel, or cast iron, and may be solid or the lattice type. Because of their weight they tend to be costly. With the steel or cast-iron types care must be taken to ensure that the inclination of the earthing lead to the plate is water-proofed to prevent cathodic action taking place at the joint. If this happens, the conductor will eventually become detached from the plate and render the electrode practically useless. Plates are usually installed on edge in a hole in the ground about 2-3 meters deep, which is subsequently refilled with soil. Because one plate electrode is seldom sufficient to obtain a low-resistance earth connection, the cost of excavation associated with this type of electrode can be considerable. In addition, due to the plates being installed relatively near the surface of

the ground, the resistance value is liable to fluctuate throughout the year due to the seasonal changes in the water content of the soil. To increase the area of contact between the plate and the surrounding ground, a layer of charcoal can be interposed. Coke, which is sometimes used as an alternative to charcoal, often has a high sulphur content, which can lead to serious corrosion and even complete destruction of the copper. The use of hygroscopic salts such as calcium chloride to keep the soil in a moist condition around the electrode can also lead to corrosion.

b) Rods. In general rod electrodes have many advantages over other types of electrode in that they are less costly to install. They do not require much space, are convenient to test and do not create large voltage gradients because the earth-fault current is dissipated vertically. Deeply installed electrodes are free from seasonal resistance changes. There are several types of rod electrodes. The solid copper rod gives excellent conductivity and is highly resistant to corrosion. But it is expensive, being relatively soft, is not ideally suited for driving deep into heavy soils because it is likely to bend if it comes up against a large rock. Rods made from galvanized steel are inexpensive and remain rigid when being installed. However, the life of galvanized steel in acidic soils is short. Another disadvantage is that the copper earthing lead connection to the rod must be protected to prevent the ingress of moisture. Because the conductivity of steel is much less than that of copper, difficulties may arise, particularly under heavy fault conditions when the temperature of the electrode will rise and therefore its resistance. This will tend to dry out the surrounding soil, increasing its resistivity value and causing a general increase in the earth resistance of the electrode. In fact, in very severe fault conditions, the resistance of the rod may rise so rapidly and to such an extent that protective equipment may fail to operate.

The bimetallic rod has a steel core and a copper exterior and offers the best alternative to either the copper or steel rod. The steel core gives the necessary rigidity while the copper exterior offers good conductivity and resistance to corrosion. In the extensible type of steel-cored rod, and rods made from bare steel, steel driving caps are used to avoid splashing the rod end as it is being driven into the soil. The first rod is also provided with a pointed steel tip. The extensible rods are fitted with bronze screwed couplings. Rods should be installed by means of a power driven hammer fitted with a special head. Although rods should be driven vertically into the ground, an angle not exceeding 60° to the vertical is recommended in order to avoid rock or other buried obstruction.

c) **Strip.** Copper strip is used where the soil is shallow and overlies rock. It should be buried in a trench to a depth of not less than 50 cm and should not be used where there is a possibility of the ground being disturbed (e.g. on farmland). The strip electrode is most effective if buried in ditches under hedgerows where the bacteriological action arising from the decay of vegetation maintains a low soil resistivity.

d) **Earths mat** These consist of copper wire buried in trenches up to one meter deep. The mat can be laid out either linearly or in 'star' form and terminated at the down lead from the transformer or other items of equipment to be earthed. The total length of conductor used can often exceed 100 meters. The cost of trenching alone can be expensive. Often scrap overhead line conductor was used but because of the increasing amount of aluminium now being used, scrap copper conductor is scarce. The most common areas where this system is still used are where rock is present near the surface of the soil, making deep excavation impracticable. As with plate electrodes, this method of earthing is subject to seasonal changes in resistance. Also, there is the danger of voltage gradients being created by earth faults along the lengths of buried conductor, causing a risk to livestock.

5.3. Important Points of Earthing:

To maintain the potential of any part of a system at a definite value with respect to earth.

- I. To allow current to flow to earth in the event of a fault so that, the protective gears will operate to isolate the faulty circuit.
- II. To make sure that in the event of a fault, apparatus "Normally closed (NC)" cannot reach a dangerous potential with respect to earth.

5.4. Electric Shock:

This is the passage of current through the body of such magnitude as to have significant harmful effects these values of currents are;

1mA-2mA	Barely perceptible, no harmful effects
5mA-10mA	Throw off, painful sensation
10mA-15mA	Muscular contraction, cannot let go
20mA-30mA	Impaired breathing
50mA and above	Ventricular fibrillation and death.

There are two ways in which we can be at risk.

a-) Touching live parts of equipment for systems. That is intended to be live. This is called direct contact.

b-) Touching conductive parts which are not meant to be live, but which have become live due to a fault. This is called indirect contact.

5.5. Earth testing

IEE Regulations requires that tests be made on every installation to ensure that the earthing arrangement provided for that installation is effective and offers the users of the installation a satisfactory degree of protection against earth-leakage currents. The following are the individual tests prescribed by the Regulations.

I. Circuit-protective conductors

Regulation 713-02-01 requires that every circuit-protective conductor (CPC) be tested to verify that it is electrically sound and correctly connected. The IEE Regulations Guidance Notes on inspection and testing give details on the recognized means used to test the CPC. For each final circuit, the CPC forms part of the earth-loop impedance path, its purpose being to connect all exposed conductive parts in the circuit to the main earth terminal. The CPC can take a number of forms. If metallic conduit or trunking is used, the usual figure for ohmic resistance of one-meter length is 5 milliohms/m.

Generally if the total earth-loop impedance (Z_s) for a particular final circuit is within the maximum Z_s limits, the CPC is then regarded as being satisfactory. However, some testing specifications for large installations do require a separate test of each CPC to be carried out. The following descriptions of such tests refer to a.c. installations.

n. Reduced a.c. test.

In certain circumstances, the testing equipment in the a.c. test described above is not always available and it is often necessary to use hand-testers, which deliver a low value of test current at the frequency of the mains supply. (Allowing for the resistance of the test lead, a value for impedance of 0.5 ohm maximum should be obtained where the CPC, or part of it, is made from steel conduit. If the CPC is in whole or in part made of copper, copper-alloy, or aluminium, the maximum value is one ohm.

III. Direct current.

Where it is not convenient to use a.c. for the test, D.C. may be used instead. Before the D.C. is applied, an inspection must be made to ensure that no inductor is incorporated in the length of the CPC. Subject to the requirements of the total earth-loop impedance, the maximum values for impedance for the CPC should be 0.5 ohm (if of steel) or one ohm (if of copper, copper-alloy or aluminium).

The resistance of an earth-continuity conductor, which contains imperfect joints, varies with the test current. It is therefore recommended that a D.C. resistance test for quality is made, first at low current, secondly with high current, and finally with low current. The low-current tests should be made with an instrument delivering not more than 200 mA into one ohm; the high-current test should be made at 10 A or such higher current as is practicable. The open-circuit voltage of the test set should be less than 30 V. Any substantial variations in the readings (say 25 per cent) will indicate faulty joints in the conductor; these should be rectified. If the values obtained are within the variation limit, no further test of the CPC is necessary.

IV. Residual current devices

IEE Regulation 713-12-01 requires that where an RCD provides protection against indirect contact, the unit must have its effectiveness tested by the simulation of a fault condition. This test is independent of the unit's own test facility. The consumer who is advised to ensure that the RCD trips when a test current, provided by an internal resistor, is applied to the trip-coil of the unit designs the latter for use. Thus, on pressing the 'Test' button the unit should trip immediately. If it does not it may indicate that a fault exists and the unit should not be used with its associated socket-outlet, particularly if the outlet is to be used for outdoor equipment. The RCD has a normal tripping current of 30 mA and an operating time not exceeding 40 ms at a test current of 150 mA.

RCD testers are commercially available, which allow a range of tripping currents to be applied to the unit, from 10 mA upwards. In general the lower the tripping current the longer will be the time of disconnection:

It should be noted that a double pole RCD is required for caravans and caravan sites and for agricultural and horticultural installations where socket-outlets are designed for equipment to be used other than 'that essential to the welfare of livestock'.

V. Earth-electrode resistance area

The general mass of earth is used in electrical work to maintain the potential of any part of a system at a definite value with respect to earth (usually taken as zero volts). It also allows a current to flow in the event of a fault to earth, so that protective gear will operate to isolate the faulty circuit. One particular aspect of the earth electrode resistance area is that its resistance is by no means constant. It varies with a amount of moisture in the soil and is therefore subject to seasonal and other changes. As the general mass of earth forms part of the earth-fault loop path, it is essential to know its actual value of resistance, and particularly of that area within the vicinity of the earth electrode. The effective resistance area of an earth electrode extends for some distance around the actual electrode; but the surface voltage dies away very rapidly as the distance from the electrode increases. The basic method of measuring the earth-electrode resistance is to pass current into the soil via the electrode and to measure the voltage needed to produce this current. The type of soil largely determines its resistivity. The ability of the soil to conduct currents is essentially electrolytic in nature, and is therefore affected by moisture in the soil and by the chemical composition and concentration of salts dissolved in the contained water. Grain size and distribution, and closeness of packing are also contributory factors, since these control the manner in which moisture is held in the soil. Many of these factors vary locally. The following table shows some typical values of soil resistivity.

Table 2. soil-resistivity values

Type of soil	Approximate value in ohm-cm
Marshy ground	200 to 350
Loam and clay	400 to 15,000
Chalk	6000 to 40,000
Sand	9000 to 800,000
Peat	5000 to 50,000
Sandy gravel	5000 to 50,000
Rock	100,000 upwards

When the site of an earth electrode is to be considered, the following types of soil are recommended, in order of preference:

1. Wet marshy ground, which is not too well drained.

2. Clay, loamy soil, arable land, clayey soil, and clayey soil mixed with small quantities of sand.

3. Clay and loam mixed with varying proportions of sand, gravel, and stones.

4. Damp and wet sand, peat.

Dry sand, gravel, chalk, limestone, whitist(tit); granite, and any very stony ground should be avoided, as should all locations where yirgil'lföck is very close to the surface.

Chemical treatment of the soil is sometimes used to improve its conductivity. Common salt is very suitable for this purpose. Calcium chloride, sodium carbonate, and other substances are also beneficial, but before any chemical treatment is applied it should be verified that no corrosive actions would be set up, particularly on the earth electrode. Either a hand-operated tester or a mains-energized double-wound transformer can be used, the latter requiring an ammeter and a high-resistance voltmeter. The former method gives a direct reading in ohms on the instrument scale; the latter method requires a calculation in the form:

$$\text{Resistance} = \frac{\text{Voltage}}{\text{Current}}$$

The procedure is the same in each case. An auxiliary electrode is driven into the ground at a distance of about 30 meters away from the electrode under test (the consumer's electrode). A third electrode is driven midway between them. To ensure that the resistance area of the first two electrodes do not overlap, the third electrode is moved 6 meters farther from, and nearer to, the electrode under test. The three tests should give similar results, the average value being taken as the mean resistance of the earth electrode.

One disadvantage of using the simple method of earth electrode resistance measurement is that the effects of emfs (owing to electrolytic action in the soil) have to be taken into account when testing. Also, there is the possibility of stray earth currents being leakages from local distribution systems. Because of this it is usual to use a commercial instrument, the Megger earth tester being a typical example.

VI. Earth-fault loop impedance

Regulation 113-11-01 stipulates that where earth-leakage relies on the operation of over current devices, an earth-loop impedance test should be carried out to prove the effectiveness of the installation's earthing arrangement. Although the supply authority makes its own earth-

loop impedance tests, the electrical contractor is still required to carry out his own tests. The tests carried out by a supply authority will not absolve the contractor from his legal responsibilities for the safe and effective operation of protection equipment which he may install as part of a wiring installation. This applies both to new installations and extensions to existing installations. Earth-loop impedance tests must be carried out on all extension work of major importance to ensure that the earth-continuity path right back to the consumer's earthing terminal is effective and will enable the protective equipment to operate under fault conditions.

VII. Phase-earth loop test.

This test closely simulates the condition which would arise should an earth-fault occur. The instruments used for the test create an artificial fault to earth between the live and earth conductors, and the fault current, which is limited by a resistor or some other means, is allowed to flow for a very short period. During this time, there is a voltage drop across the limiting device, the magnitude of which depends on the value of the earth loop. The voltage drop is used to operate an instrument, with an associated scale calibrated in ohms.

The contribution of the should be not more than one ohm. This is to ensure that the voltage drop across any two points on the conductor is kept to a low value and, under fault conditions there will be no danger to any person touching it at the time of the test.

The testers, which are commercially available, include both digital readouts and analogue scales, and incorporate indications of the circuit condition (correct polarity and a proven earth connection). The readings are in ohms and represent the earth-loop impedance (Z_s). Once a reading is obtained, reference must be made to IEE Regulations Tables 4181 to 41D, which give the maximum values of Z_s which refer to: (a) the type of over current device used to protect the circuit and (b) the rating of the device. Reference should also be made to any previous test reading to see whether any increase in Z_s has occurred in the meantime. Any increase may indicate a deteriorating condition in the CPC or earthing lead and should be investigated immediately. The values of Z_s indicated in the Tables are maximum values, which must not be exceeded if the relevant circuits are to be disconnected within the disconnection times stated.

Before a test is made, the instrument should be 'proved' by using a calibration unit, which will ensure that it reads correctly during the test. It is also recommended that the serial number and

type or mode¹ used for the test should be recorded, so that future tests made by the same tester will produce readings, which are correlated.

CHAPTER 6:

CABLES

6.1. Types of Cables:

1. Single core cable
2. Two-core cable
3. Three-core cable
4. Composite cable
5. Power cable
6. Wiring cable
7. Overhead cable
8. Equipment cable
9. Appliance Wiring cable
10. Twin Twisted cable
11. Three-Core Twisted
12. Twin Circular cable
13. Three Core
14. Coaxial cable
15. Tel. cable

The range of types of cables used in electrical work is very wide: from heavy lead-sheathed and armored paper-insulated cables to the domestic flexible cable used to connect a hair-drier to the supply. Lead, tough-rubber, PVC and other types of sheathed cables used for domestic and industrial wiring are generally placed under heading of power cables. There are, however, other insulated copper conductors (they are sometimes aluminum), which, though by definitions are termed cables, are sometimes not regarded as such. Into this category fall for these rubber and PVC insulated conductors drawn into some form of conduit or trucking

for domestic and factory wiring, and similar conductors employed for the wiring of electrical equipment. In addition, there are the various types of insulated flexible conductors including those used for portable appliances and pendant fittings.

The main group of cables is 'flexible cables', so termed to indicate that they consist of or more cores, each containing a group of wires, the diameters of the wires and the construction of the cable being such that they afford flexibility.

Single-core.

These are natural or tinned copper wires. The insulating materials include butyl-rubber, silicon-rubber, and the more familiar PVC.

The synthetic rubbers are provided with braiding and are self-colored. The IEE Regulations recognize these insulating materials for twin- and multi-core flexible cables rather than for use as single conductors in conduit or trunking wiring systems. But that are available from the cable manufacturers for specific insulation requirements. Sizes vary from 1 to 36 mm squared (PVC) and 50 mm squared (synthetic rubbers).

Two-core.

Two-core or 'twin' cables are flat or circular. The insulation and sheathing materials are those used for single-core cables. The circular cables require cotton filler threads to gain the circular shape. Flat cables have their two cores laid side by side.

Three-core.

These cables are the same in all respects to single- and two-core cables except, of course, they carry three cores.

Composite cables.

Composite cables are those, which, in addition to carrying the current-carrying circuit conductors, also contain a **protective conductor**.

To summarize, the following group of cable types and applications are to be found in electrical work, and the electrician, at one time or another during his career, may be asked to install them.

Wiring cables.

Switchboard wiring; domestic and workshop flexible cables and cords. Mainly copper

conductors.

Power cables.

Heavy cables, generally lead sheathed and armored; control cables for electrical equipment.

Both copper and aluminum conductors.

Mining cables.

In this field cables are used for trailing cables to supply equipment; shot-firing cables; roadway lighting; lift-shaft wiring; signaling, telephone and control cables. Adequate protection and fireproofing are features of cables for this application field.

Ship-wiring cables.

These cables are generally lead-sheathed and armored, and mineral-insulated, metal-sheathed. Cables must comply with Lloyd's Rules and Regulations, and with Admiralty requirements.

Overhead cables.

Bare, lightly-insulated and insulated conductors of copper, copper-cadmium and aluminum generally. Sometimes with steel core for added strength. For overhead distribution cables are PVC and in most cases comply with British Telecom requirements.

Communication cables.

This group includes television down-leads and radio-relay cables; radio frequency cables; telephonocables.

Welding cables.

These are flexible cables and heavy cords with either copper or aluminum conductors.

Electric-sign cables.

PVC-and-rubber-insulated cables for high-voltage discharge lamps able to withstand the high voltages.

Equipment wires.

Special wires for use with instruments, often insulated with special materials such as silicon, rubber and irradiated polythene.

Appliance-wiring cables.

This group includes high-temperature cables for electric radiators, cookers, and so on.

Insulation used includes nylon, asbestos, and varnished cambric.

Heating cables.

Cables for floor-warming, road-heating, soil-warming, ceiling-heating, and similar applications.

Flexible cords.

A flexible cord is defined as a flexible cable in which the csa of each conductor does not exceed 4 mm squared. The most common types of flexible cords are used in domestic and light industrial work. The diameter of each strand or wire varies from 0.21 to 0.31 mm.

Flexible cord come in many sizes and types; for convenience they are grouped as follows:

I. Twin-twisted: These consist of one single insulated stranded conductors twisted together to form a core-cable. Insulation used is vulcanized rubber and PVC. Color identification in red and black is often provided. The rubber is protected by a braiding of cotton, glazed-cotton, and rayon-barding and artificial silk. The PVC-insulated conductors are not provided with additional protection.

II. Three-core (twisted): Generally as two -twisted cords but with a third conductor colored green, for earthing lighting fittings.

III. Three-core (circular): Generally as twin-core circular except that the third conductor is colored green and yellow for earthing purposes.

IV. Four-core (circular): Generally as twin-core circular. Colors are brown and blue.

V. Parallel twin: These are two stranded conductors laid together in parallel and insulated to form a uniform cable with rubber or PVC.

VI. Twin-core (flat): This consists of two stranded conductors insulated with rubber, colored red and black. Lay side-by-side and braided with artificial silk.

VII. High-temperature lighting, flexible cord: With the increasing use of filament lamps which produce very high temperatures, the temperature at the terminals of a lamp holder can reach 71 centigrade or more. In most instances the usual flexible insulators (rubber and PVC) are quite unsuitable and special flexible cords for lighting are now available. Conductors are generally of nickel-plated copper wires, each conductor being provided with two lapping of glass fiber. The braiding is also varnished with silicone. Cords are made in the twisted form (two- and three-core).

VIII/Flexible cables: These cables are made with stranded conductors, the diameters being 0.3, 0.4, 0.5, and 0.6 mm. They are generally used for trailing cables and similar applications where heavy currents up to 630 A are to be carried, for instance, to welding plant.

IX. Coaxial cables (antenna cable):

Antenna cables is a special cable which is used to transfer high frequency. This cable is a type of flexible cables. We use this cable for TV. We are using this type of cable between television sockets and from television to antenna.

X. Telephone cables:

Telephone cable is special cable. We use telephone circuit in the buildings and also for intercom circuits. These cables are very slim. Telephone cables are not same as electric cables. There are a lot of size the telephone cables. Telephone cables are 0.5mm and everytime one cable is extra near this cables.

Table 3. Telephone cables sizes

1x2+0.5 mm
2x2+0.5 mm
3x2+0.5 mm
4x2+0.5 mm
6x2+0.5 mm
10x2+0.5 mm
15x2+0.5 mm
20x2+0.5 mm ²

6.2 Conductor Identification:

The wiring regulations require that all conductors have to be identified by some meaning to indicate their functions i.e. phase conductors of a 3 phase system are colored by red, yellow, blue with neutral colored by black, protective conductors are identified by green or yellow/green. In British Standard;

Red	Phase
Black	Neutral
Green	Earth

We have some methods to identify the conductors.

1. Colouring of the conductor insulation
2. Printed numbers on the conductor
3. Coloured adhesive cases at the termination of the conductor
4. Colored see levels types at the termination of the conductors
5. Numbered paint for bare conductors
6. Colored discs fixed to the termination of conductors' e.g. on a distribution board.

Table 4. Standard thickness of cables

Cable size
0.75 mm
1mm
1.5 mm ²
2.5 mm ²
4 mm ²
6 mm ²
10 mm ²
16 mm ²
25 mm ²
35 mm ²
50 mm ²
70 mm ²
90 mm ²
120 mm ²
150 mm ²
185 mm ²
240 mm ²
300 mm ²
400mm~
500mm
630mm

CHAPTER 7.

PLASTIC PIPES

In past, iron pipes were used but in today's the plastic pipes is used. They can bended however you want. Their life is long and also they do not effect from corrosion. You can work easily with them. They are produced at standard sizes and length, which is 3 meters.

Table 4. Plastic pipes thickness and length

Inch	MM	Length (M)
5/8		3
3/4		3
1		3
1 1/4		3
1 1/2		3
2		3

CHAPTER 8.

TYPES of INTAKE POSITION

There are two types of intake position;

1. Over-Head Transmission Lines

2. Underground Transmission Lines

8.1. Over-Head Transmission Lines

The metal is put (J) on to building, which is near to the transmission lines. We connect the lines, which are coming from pillar; to the "T Point", and, the lines will be gotten into the box of the metering units.

8.2. Under-ground Intake:

Lines are taken from pillar but here under-ground cable is used. When the cable put under-ground, it will be done in some rules. These rules are;

1. Earth will be dugged (depth nearly 100 cm)
2. Sand will be separated in channel
3. Plastic pipes will be put into channel
4. Again sand is separated onto pipes
5. And these are covered by cement
6. Cable will be passed through the pipes to the box of metering units.

After these the lines are connected to the HRC (High Rupturing Fuses) fuses. And then, Cutout, metering unit, operator, and distribution board.

CHAPTER 9.

DOMESTIC INSTALLATIONS

9.1 General Rules for Domestic Installation

There are two types of installation

I. Surface Installation

II. Under plaster installation

Installation system at costumers place

OPERATOR ➡ DISTRIBUTION BOARD ➡ FUSES ||||| LINES (CABLES)

In both types of installation, same main principle is accepted these are;

1. Lines from metering unit will be applied to the operator (V/0, C/0) or if operator is in distribution board, we put 2-pole isolator into box of metering unit and earth continuity conductor will come from another place, not with line and neutral conductor. If the operator is outside of the operator line neutral earth will be connected together to 2-pole isolator, which is in distribution board. These maybe 3 phase or 1 phase operator or isolator.

2. In distribution board for each type of circuit different cable sizes and fuses or miniature circuit breakers are used.

9.2. POWER CIRCUITS

1. Sockets

There are two types of sockets.


- I. Radial Socket Circuit
- II. Ring Socket Circuit

a-) Radial Socket Circuit:

We have some standards.

- 1-) In a kitchen area two sockets can be put in radial socket circuit with 2.5 mm" conductor and 15 amps. fuse.
- 2-) In an area, which is not in kitchen and less, than 30 m² 6 sockets can be put in radial circuit with 2.5 mm² conductors and 15 Amp. fuse.
- 3-) If the area is greater than 30 m², 6 sockets can be put in a radial socket cet. With 4 mm² conductor and 20 Amp. fused.

Figure 1. Radial socket circuit

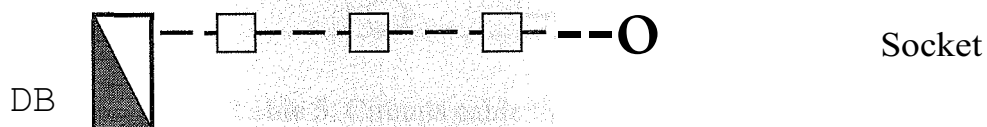

b-) Ring Socket Circuit:

Ring means, you will start from one point and after you went to each point, you will come back to first point.

1-) Any number of socket can be put in a ring socket circuit if the area less than 100 m² if area is greater than 100 m² in any building. You have to another ring socket circuits.

2-) From any sockets in a ring sockets circuits you can put spur from each sockets.

3-) Only one stationary appliance can be put in a ring socket circuit either include in the ring or taken as a spur. (Washing machine, dish washer, bathroom heater or heater, and water pump)

NOTE: If these are connected to the ring socket circuit as a spur or with any heater switch. The heater switch has to be fused.

For other power circuits of fuse.

Figure 2. Ring socket circuit

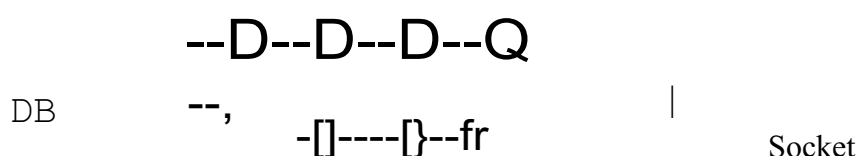


Figure 3. Ring socket circuit with spur sockets

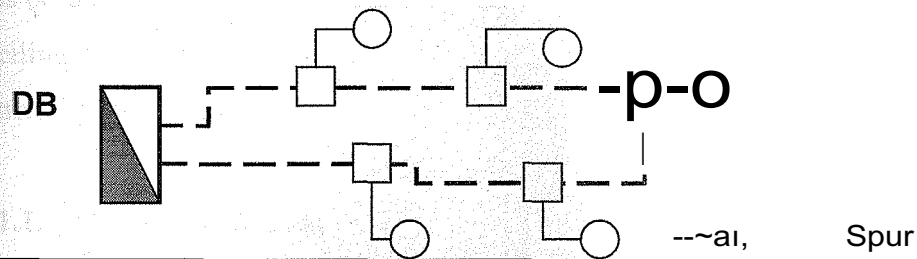


Table 5. Circuits cable thickness and fuses

Circuit	L+N	Earth	Fuses
Cooker Control	6 mm ²	2.5 mm ²	30A
Heater	2.5 mm ²	1 mm"	15 A
Dish Washer	2.5 mm ²	1 mm"	15 A
Washing machine	2.5 mm ²	1 inmm"	15 A
Jacuzzi	2.5 mm ²	1 mm ²	5A
Instant Heater	4 mm ²	2.5mm"	5A
Air Conditioner	2.5-4mm ²	1-2.5 mm ²	30 A

9.3. LIGHTING CIRCUITS

In lighting circuits generally, 1 mm² cable is used with 5 A fuse because the authority says that in a lamb circuit you will put 10 lamp (100 W), this will be 1 kW= $I = \sqrt{1kW/240} = 4.16$ A. 5 A limit must not be passed that's why we use the five A fuse. If we want to put more than 10 lamps in a circuit we have to choose 1.5 mm² with a 10 A fuse.

9.4. TYPES of DOMESTIC INSTALLATION

There are two types of installation; Surface Installation and under plaster installation.

9.4.1. Under Plaster Installation

Steps do this type of installation as follows;

- I. Ceiling installation and stairs.
- II. Inside of home and stairs.

9.4.1.1. Ceiling Installation;

Plastic pipes and plastic lamb box do this part of installation. Generally, 5/8 plastic pipes are used for cell lighting. While we are doing these also, pipes of stairs installation is fixed. Pipes and lamb boxes are out be cording to the electric installation project.

Following steps to do these.

a-) Ceiling installation and stairs. First the lamp boxes are filled by wet papers. Lamps boxes may fill with concrete there fore we fill the inside of lamp boxes with paper not to have problem.

b-) Lamps boxes will be nailed according to the electrical plan. If there is only single lamp in a room. Lamp boxes will be nailed to the center of room. If there is more than one lamp. You have to follow a special ways. For example, in a corridor generally there are two lamps length of corridor will be divided by there and with will be divided two to point the place of lamp.


c-) You will take out the pipes boxes for switches (to under of the roof). We have to be careful. When we put the pipes inside of the coulomb the pipes, which will be under roof, must not be above doors or windows and also, it should not be behind doors.

d-) For each circuit, from the lamb boxes/pipes will be taken out up to the distribution board. This is done as same as position of switches.

e-) Pipes will be put for the heater and for the water tank on the roof to the distribution board.
(3/4")

f-) For antenna and telephone lines pipes are fixed to the suitable position (1" or 3/4"). In apartments extra pipes are put in stairs for main lines and for the lighting of stairs. They are put inside of the coulomb

Figure 4. Ceiling installation samples

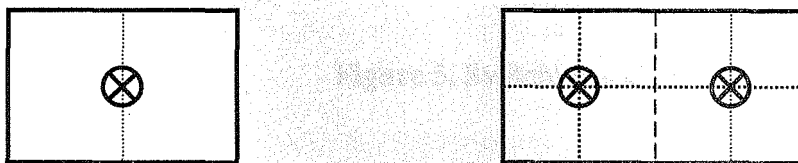

9.4.1.2. Inside of Home and Stairs.

According to the plan, you paint the positions of sockets, switches, etc. with paint (spray paint). Painted places have to be broken. Metal boxes and plastic pipes that are in different sizes, for each type of circuit.

5/8" pipes for lighting, telephone lines, water pump, and earthing.

3/4" for sockets, antenna, heater circuits.

3/4" or 1" for cooker control

1 1/4" or thicker is used for main lines,

When the metal boxes are being put they have to have different heights. These heights are;

bathroom, dinning rooms, corridor, sockets/Telephone/ Antenna sockets 50cm
(between floor to metal box)

Switches 150cm (between floor to metal box)

Special lamps on wall 200cm (between floor to metal box)




Figure 5. Switch or socket box

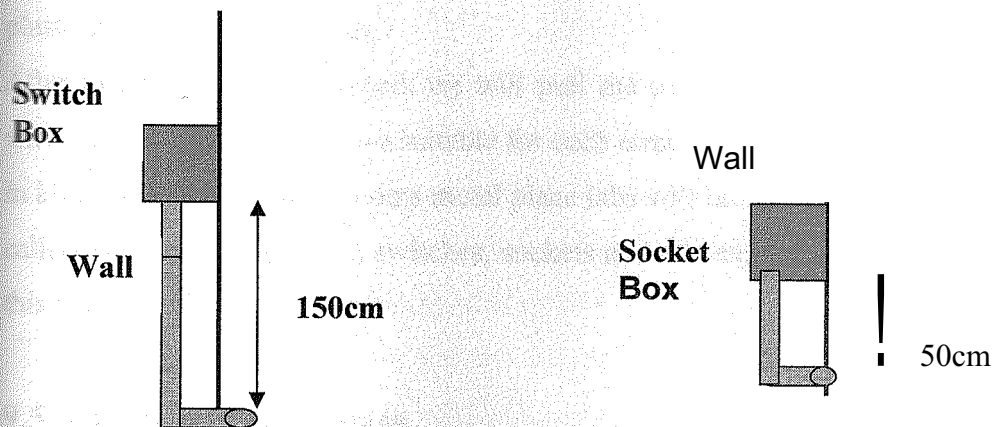


Figure 6. Height of switch and socket boxes

In Kitchen;

Here you have to be careful for position of metal boxes. Because cooker, switches, sockets boxes have to be at the same line and you have to measure careful not to put them on the place of the cupboards and this height is generally 125cm.

In Toilet and Bathrooms;

You must not put the metal box of switches inside of toilets or bathrooms. Because you may have risk of electric shock. Lamps must be waterproof. In these wet places, we have to use waterproof components for protection of life. Height of lamp is nearly at 200cm.

The round of the metal boxes must not be plastered because, metal box will have corrosion problem.

Steps

a-) We paint the places of switches, sockets, etc.

b-) Painted places have to be broken, up to 65cm for sockets, switches 150cm, if the pipes of switch will come from roof, that pipe will come to 150cm painted line.

c-) Metal box will be fixed at painted places, but they have to be flat and good appearance we tie with wire on a piece of flat wood. This wood is nailed to the wall.

d-) We bend the pipes from anywhere of pipes, where it is needed and put them in boxes from hole on box.

e-) After plasterer to boxes which are on floor are also plastered to protect the

After these have been connecting to the special stainless wire. What types of

in kit by special clips which is

called earthen clips these will be connected and

this is called finish.

9.5."Choosing Cable Sizes

The selection of the size of a cable to carry a load current involves the consideration of the rating and type of the protective device, the ambient temperature, and whether other cables are run alongside the cable (grouping). There are many situations in which cables can find themselves being overheated. The more obvious are the conditions set up when over currents are carried due to overloading and when a short-circuit occurs. Others include the increase in temperature when a number of current carrying cables are bunched together, for instance in conduit and trunking, which is a situation in which each cable contributes its heat to that of others and which, because of the enclosed situation, produces an environment, which can quickly lead to the deterioration of the cable insulation (particularly when PVC is involved) and lead to a possible source of fire. At about 80 °C, PVC becomes very soft, so that a conductor can 'migrate' or travel through the insulation and eventually make contact with earthed metalwork. This produces a shock-risk situation, with an increase in the leakage current which could prove fatal if the installation earthing arrangement is faulty. Eventually,

when the insulation breaks down completely, a short-circuit occurs and the circuit is now dependent on the ability of the over-current protection device to operate to disconnect the circuit from its supply. As is probably realized, the time of operation of the protective device is crucial: a semi-enclosed fuse will take longer to operate than would a miniature circuit breaker. In some circumstances, particularly where PVC insulated cables are used, the time taken by a semi-enclosed fuse to operate may be long enough for the cables to burn out and create a fire hazard.

Another problem, in buildings, with the that, in these classifications are ins

clipped direct' (e.g. thermally-insulating, and suspended from include cables in free air; and cables 'in enclosed trenches'.

From this, it can be seen and appreciated that the selection of a cable to feed a circuit is now required to be undertaken with a number of factors to be considered carefully. Situations, which were formerly taken for granted must now be investigated so that the cable is installed in the best conditions, which will allow the cable to carry its load current with the safety of user of the installation in mind.

IEE Regulations require that the choice of a cable for a particular circuit must have due regard for a number of factors, and not just the circuit current. These factors include:

- a) the ambient temperature in which the cable is installed;
- b) the installation condition, e.g. whether grouped or bunched with other current-carrying cables, enclosed or installed open';
- c) whether the cable is surrounded by or in contact with thermal insulating material;
- d) whether the circuit is protected by semi-enclosed (rewirable) fuses to BS 3036.

The method of choosing the correct size of conductor for a particular load condition, as recommended by the IEE Regulations, is based on the rating of the over current protective device. All factors affecting the cable in its installed condition are applied as divisors to the rating of the device. In general, the size of every bare conductor or cable conductor shall be such that the drop in voltage from the origin of the installation to any point in that installation does not exceed 4% of the nominal voltage when the conductors are carrying the full load

concerns the use of thermal insulation where the natural heat produced by even The IEE Regulations recognize the fact to be reduced quite considerably. These capacities of cables. The

'trunking and ducts); 'open and embedded direct in plaster which is not wire); 'defined conditions', which

current. It should be noted that conductors of large cross-sectional area have different volt drops per ampere per meter for ac circuits than those operating from dc supplies. This is because of the reactance inherent in conductors carrying ac.

The following process for working out the correct size of cables is as follows:

1. First find the load current of the circuit (I_B).

2. Determine the correction

temperature, which of course does not

include

is more concerned with the maximum

temperature of the medium

3. Determine the correction

4. Determine the

with or is surrounded by thermal

insulation material.

one side of the cable is in contact with

the material (e.g. a cable

and 0.5 if the cable is completely

surrounded by the material)

5. Select the rating of the

is offering what used to be called 'close'

protection, the

is by means of a semi-enclosed

fuse

equal the load current.

6. Determine the size

7. Check that the volt drop does not exceed

allowed.

If I_z represents the

the rating of the protective device,

then

$$I_z = \frac{I_n}{C_g \times C_a \times C_i \times C_f} \quad \text{amperes}$$

where C_g is the factor

C_a is the factor for the type of cable

C_i

cable is surrounded and 0.75 if the insulation is

in

C_f is the factor for the

is 1 for all devices except semi-

enc

CHAPTER 10.

SPECIAL INSTALATIONS

Though the bulk of electrical installation work carried out in this country does not involve the consideration of special factors in the context of the wiring systems, accessories and the equipment to be used in an installation; there are some types of installation conditions which call for special consideration. These conditions create the need for what are called in this chapter 'special installations', which tend to fall out with the general run of installations and require their special and particular requirements to be satisfied. These special installations are dealt with in the IEE Regulations in a rather general way and the electrician must therefore consult other sources of information as to installation procedures, techniques, and recommended types of equipment. These sources include BS Codes of Practice and manufacturers' instructions, and IEE Regulations.

10.1 Damp Situations

In general terms a 'damp situation' is one in which moisture is either permanently present, or intermittently present to such an extent as to be likely to impair the effectiveness of an installation conforming to the requirements for ordinary situations. These situations create a hazard from electric shock (particularly from surface leakage over otherwise healthy insulation) and the risks, which attend a gradual deterioration of the metalwork of the installation as the result of corrosion.

The IEE Regulations require that every cable installed in a damp situation, and where it is exposed to rain, dripping water, condensed water, and accumulations of water, shall be of a type designed to withstand these conditions. In addition all metal sheaths and armour of cables, metal conduit, ducts or trunking, and clips and their fixings, shall be of corrosion-resisting material. In particular, they should not be placed in contact with other metals with which they are liable to set up electrolytic action. If steel conduit is involved in such damp installations, it must be of heavy gauge. Conduit threads should be painted over with a bituminous paint immediately after erection. Cables, which are armoured and destined for installation in a damp situation, are required to have further protection in the form of an overall PVC sheath.

Even though an installation is not classed as 'damp', there may occasionally arise a situation, which could place it in this category. This is one result of condensation, which, though it might occur intermittently, may well appear in the form of a considerable quantity of

condensate. Condensation exists where there is a difference in temperature, for where equipment is installed inside a room in which the ambient temperature is higher than the equipment being controlled by switchgear outside the room in a lower ambient temperature. If the switchgear and the equipment are connected by trunking or conduit, then condensation is likely to occur. It will also occur where there is a high ambient temperature during the day and where the temperature subsequently falls when the room is unoccupied during the night. Generally, whenever moisture, whatever its source, is present, galvanized or sherardized metalwork is recommended. In addition, conditions may be such that fixing accessories and materials may suffer from a corrosive action that might occur. If conduit is used, drip points should be provided so that water can drip away. Long runs of conduit should be slightly offset to allow any accumulated condensate to run to a drain point at the lowest level.

The problem of condens

refrigeration plant. Switchgear and cold rooms in a position some reasonable distance from door openings where changes in temperature lead to condensation. Lead-sheathed types should be glanded into cold chambers on wood battens. Cable entry should be sealed with some bituminous material. It is important to recognize that high temperatures will injure the cables. At temperatures below the characteristic and may crack if hit sharply. Cables with bituminous-compounded beddings or servings.

installations and around switchgear should be installed outside the room from blasts of cold air and clear of door openings to occur. Cables of the MICS and totally enclosed lighting fittings and run into the cold chambers should be sealed with some bituminous material. PVC cables in low temperatures, 0°C, PVC has a 'cold-shatter' characteristic and a warning note regarding the use of

10.2 Corrosion

Wherever metal is used there is the attendant problem of corrosion. Two conditions are necessary for corrosion: a susceptible metal and a corrosive environment. Nearly all of the common metals in use today corrode under most natural conditions; the bulk of all anti-corrosive measures have thus been attempts either to isolate the metal from its environment, or to changing the environment chemically to render it less corrosive. In installation work, the problems of corrosion tend to be more acute in certain types of installation. Chemical works, salt works, cow byres and other ammonia-affected areas, all require special consideration in their design and the work executed to produce the installation. Corrosion, in a normal installation condition, may affect earth connections.

The corrosion of metals in contact with soil or water is an electrochemical reaction; that is, the

Corrosion reaction involves both the chemical change (e.g., from iron to rust) and a flow of electric current. It is this principle, which is used in the dry cell, where the corrosion of the zinc case provides the cell's electrical output. The current flows from the metal into the soil or water (called the electrolyte) at the anode and then from the electrolyte into the metal at the cathode. Corrosion occurs at the point where the current flows from the metal into the electrolyte. Every metal develops its own particular electrode potential when placed in an electrolyte or similar medium. If two different metals are coupled together in the same electrolyte, the difference between their potentials will be sufficient to produce a current of electricity. The metal with the more negative potential will suffer corrosion. It follows that the more compatible the metals, the less the rate of progress of any corrosive action which takes place between them. A small amount of potential difference between them is reduced.

In general there is a potential difference between a buried mass of metal and its surrounding soil. This potential is measured by a device called a half-cell, which consists of a sulphate solution contained in a plastic tube in contact with the soil as near as possible to the buried mass. The half-cell will act as anodes (where the current leaves the mass) and cathodes (where the current enters the mass) depending upon the relative positions of the areas of the surface of the buried mass and the electrolyte.

V between a buried mass of metal and its surrounding soil. This potential is measured by a very-high-resistance voltmeter and a half-cell immersed in saturated copper sulphate solution. The half-cell is connected to the mass by a porous plug at the bottom for making contact. Certain areas of the mass surface will corrode. The areas, which do not corrode. This sub-division in the mass is due to the fact that the areas assume the roles of anodes and cathodes depending upon the relative positions of the areas of the surface of the buried mass and the electrolyte.

Reducing the amount of current that flows from it into the surrounding medium or electrolyte can diminish the corrosion of a metal. Painting or otherwise coating the metal will increase the electrical resistance of both anodes and cathodes. But if the coating has flaws or holes in it, then the current concentrates at these points and deep pitting will occur. The corrosion current can also be reduced by lowering the electrical potential difference between the anodes and the cathodes either by controlling the purity of the electrolyte or by adding inhibitors to it. Because only the anodes corrode, current flowing into them from an introduced external anode so as to cause the whole of the buried structure to become a cathode can prevent corrosion. This is the principle of cathodic protection. The method can be used only where the introduced anode can be accommodated within the electrolyte that surrounds the buried metal, and the soil or water must be present in bulk.

The method is widely employed as a corrosion preventive measure on underground

metalwork. Two basic techniques are used to give cathodic protection: (i) the sacrificial anode system; (ii) the impressed current system.

In the first method, a mass of base metal such as magnesium, is buried in the electrolyte and connected electrically to the structure to be protected. The natural difference in potential between the structure metal, usually steel, and the magnesium causes a current to flow from the magnesium (the new anode) through the electrolyte to the steel, which is the new Cathode. The anode gradually corrodes and is thus called a 'sacrificial anode'. In practice a closely controlled magnesium-alloy is used. The main factors which govern the degree of protection, and the current output from the galvanic cell so formed by the protective system, are the surface area, volume, and shape of the anode used, the resistivity of the electrolyte and the surface area of the exposed metal. The sacrificial anode system is common in congested areas since the galvanic system virtually eliminates the possibility of corrosion on account of stray current. The system also needs no external supply and is to a great extent self regulating in output, which latter will vary according to the conditions of the surrounding medium (e.g., in wet or dry weather conditions). The anode conditions, the life of an anode may be up to

The second method of protection, the impressed current system, uses a conventionally generated direct current from rotating machinery. The negative side of the supply is connected to the structure to be protected; the positive side is fed to an 'anode ground-bed' usually formed of graphite impregnated by resin, wax or linseed oil, silicon iron or scrap metal. The anode structure then becomes the cathode. The anode and graphite anode ground-beds are semi-inert and have a life of 10 years or more. Scrap steel beds go into solution quite rapidly and disintegrate.

10 kg/Ampere/year.

The metalwork associated with electrical installations, which may require cathodic protection include supporting lattice structures, armoured cables with rotted servings, metal pipes containing cables, and general structural steelwork.

Another aspect of corrosion may not be too familiar to installation installers. This concerns the continuous exposure of PVC-insulated cables to temperatures above 115°C that may cause the formation of corrosive products, which can attack conductors and other metalwork.

Generally, the precautions to prevent the occurrence of corrosion in normal installations

include:

1. The prevention of contact between two dissimilar metals (e.g. copper and aluminium), particularly where dampness is likely to be present.
2. The protection of cables, wiring Systems and equipment against the corrosive action of water, oil, and dampness, unless they are designed to withstand these conditions.
3. The protection of metal sheaths of cables and metal-conduit fittings where they come into contact with lime, plaster, cement and certain hardwoods such as beech and oak.
4. The use of bituminous paints and PVC over sheathing on metallic surfaces liable to corrosion in service.

10.3. Sound Distribution Systems

Sound-distribution Systems consist essentially of loudspeakers permanently installed in suitable positions in buildings or in open spaces associated with buildings - They are essentially part of the telecommunications Systems of buildings. The currents, which operate such systems, are derived from a microphone, gramophone, radio receiver, Or Other device, Or from a wire broadcasting service. These currents are of a very small order and so require to be amplified to values suitable for the operation of loudspeakers. Sound-distribution systems are found in schools, theatres and cinemas, churches, meeting halls, factories, offices and department stores, hotels and clubs, hospitals, railway stations and sports grounds. Though these systems generally operate from mains supplies, some systems, or parts thereof, operate from batteries or from mains-supplied rectified current, producing low voltages.

11.4. Personnel call Systems

These systems are used in private dwellings, hotels, schools, factories, and other premises where it is required to attract the attention of individuals to a situation or circumstance. The simplest system is where a caller calls a person to a particular position. In a private house, the householder is called to the door. A bell push or similar device is fitted at each such position and an indicator provided to show which push has been operated. A bell or buzzer is used to provide the sound, which will attract attention to the call. Bell push can be of the wall-mounted, table or pendant type; the contact points are of a metal, which gives long service without becoming pitted or corroded. If the bell push is to be installed outside, protection against the ingress of moisture must be provided.

Indicators are installed in a central position in the building. In large premises, such as hotels and factories, the indicator board is located in a room in which some person is always in

attendance, e.g., kitchen or reception office. The use of lamps is necessary where the sound of bells must be either objectionable or useless, e.g., in hospitals at night or in noisy workshops. Hand-setting indicators should be mounted at a height convenient for access and visibility.

Multiple-call systems are used in very large hotels where the call points are too many to be indicated conveniently on a single indicator board or panel. Pushes are fitted at each call point, but the circuits are grouped to serve a corridor or floor. Each group gives the indication in a central service room. In these systems, arrangements must be made to have attendants on duty in corridors or floors to deal with the calls. Multiple-call systems use indicators, which have to be reset by the attendant.

Time-bell systems are common in schools and factories to indicate the beginning or end of a time or period (e.g., break, class change, etc.). These systems usually have one or two pushes or other switches connected in parallel and a number of bells throughout the building, which are also connected in parallel. The bells can be controlled from a clock system, to eliminate the human element required with bell pushes.

The burglar-alarm system is also a call system. The switches in this case are sets of contacts mounted at doors and windows. There are two circuit types; open-circuit and closed circuit. The first type requires contacts to close to energize the bell circuit. In the closed circuit type, all contacts are closed. A circulating current energizes a series relay with normally open contacts. When a contact set is opened, this current ceases to flow, de-energizes the relay, and closes the relay contacts to ring an alarm bell. Some alarm systems operate from photoelectric cells, which work when an invisible light beam is broken. The large plate-glass windows of jewelers' shops often have a series length of very thin wire, which, if broken when the window is smashed in or a hole cut in it, will bring the relay into operation to ring a bell. In certain systems today, no bell rings, but a buzzer and light indication circuit is wired from the protected building and terminated at a nearby police station. Thus the intruder is not warned, and the police have the opportunity of catching the burglar red-handed.

The open-circuit system is seldom used because it can be interfered with. For instance, a cut in a wire will render the complete system inoperative, whereas such a break in the series circuit of a circulating-current (closed-circuit) system will immediately set an alarm-bell ringing. Supplies are sometimes from the mains, but in this instance a standby-battery supply is provided in the event of a power failure. Alarm bells are often installed in a place inaccessible to unauthorized persons, and outside the building.

Another type of call alarm system is the watchman's supervisory service. It is designed to

provide a recorded indication of the visits of watchmen or guards to different parts of a building in the course of the duty round. The system uses a clock movement of the impulse, synchronous-time controlled a.c. or 8-day clockwork type installed at each contact station throughout the building. Each station has a box with a bell push operated by the insertion of a special key. Operation of the contacts energizes an electromagnetically-operated marker which records the time of the visit on a paper marked off in hours. In some systems, an alarm is given after a predetermined time if the watchman fails to 'clock in' at any contact station. Luminous call systems are used instead of bells. These systems use color lights, which summon staff to fulfill a service duty. They are largely used in hospitals and hotels. When the bell push is pressed in any position in the building, a small lamp lights in a duty room to indicate the general area from which the call has come. Alternatively, a lamp outside the call room lights and remains so until an attendant extinguishes it by operating a reset push located just outside the room. Some systems incorporate a single-stroke bell. Call and indicating circuitry is also incorporated in lift systems.

10.5. Radio and TV

The erection of aerials for the reception of radio and TV broadcasts is usually undertaken by the specialist. In buildings, which consist of blocks of flats, communal pick-up services are provided, being fed from a communal pre-amplifier. This unit is installed as near as possible to the aerial site so that any interference picked up by the intervening feeder is reduced to a minimum. The contractor's interest in these services is mainly confined to the provision of conduit or socket-outlet facilities. In a multi-point television installation, up to twenty receiver points may be connected to one cable, which is looped through the socket-outlets.

10.6. Telephone Systems

These systems are either internal or are connected to the public telephone facilities. All installations, which have public connections, are subject to the supervision and approval of the telephone companies whose engineers normally undertake the final connecting-up. The electrical contractor is generally required to install conduit or trunking to facilitate the wiring of the building for telephone outlets. In large buildings a main switchboard is installed to receive incoming calls, which are then switched to the required extension phone. There are two types of private installations: PMBX (private manual branch exchange) and PABX (private automatic branch exchange).

In the PMBX system, each extension phone is wired to the main switchboard and connection

is made by sockets called jacks. There are certain disadvantages associated with this system, which usually requires an additional internal phone system.

In the PABX system, all incoming calls are terminated at the manual switchboard and are answered by the telephone operator. All extension to extension calls are set up automatically and direct out dialing on certain extensions is possible. All extension phones can call the operator who can identify basis. Direct access to the local

Fire Brigade

purpose. A

syst

or lamp signaling. It enables the

ope

control given by a few levers and keys.

When a call is

extension it disappears from the switchboard and is then under the full control of the extension; this is a feature not available with the older approved system known as PABX 3.

CHAPTER 11.

ILLUMINATION

11.1 Some Kinds of Lamps

Filament lamps

Filament lamps fall into a group

high

Joseph Swan

ma

use. Then the

The carbon lamps,

(battery-charging),

Swedish filter paper, which is dissolved in zinc solution. The resultant viscous solution is squirted slowly through a fine die into a solution of acidified alcohol. Tough cellulose threads are the result. They are wound on formers, which are packed into a crucible filled with finely powdered graphite. The crucibles are then baked in a furnace at 1400°C when the cellulose threads become pure carbon. The temperature limit for a carbon filament is about 1800°C . The light output is low, at about 3.6 lumens per watt (lm/W).

The tungsten-filament lamp first appeared about 1910 and has since been the main incandescent lamp in use. It operates at a temperature of about

2300°C and has a light output of about 8 lm/W. The first lamp to use a tungsten filament had the air evacuated from the glass bulb the so called vacuum lamp. Later, the bulb was filled with argon and nitrogen which are inert gases and do not support combustion. This

development enabled the filament to be operated at a higher temperature without the undue evaporation of the filament, which tends to occur in a vacuum. The operating temperature of the gas-filled lamp is about 2700°C . The light output is in the region of 12 lm/W. The early lamps had a single-coil filament. Later the coiled-coil lamp was produced, that is, the coiled filament was itself formed into a coil. The light output of the coiled-coil lamp is about 14 lm/W. The

main advantages of the

and (b) the heat losses

light output efficiency.

Tungsten has a resistance, which increases with temperature. The resistance when cold is about 6 per cent of that when operating at normal temperature. This means that when the lamp

is switched on, a current of about fourteen times the running current flows. The increase in the temperature of the filament is rapid, however, and the current surge does not harm the filament. The resistance of the filament increases as rapidly and has a stabilizing effect on the power consumed.

There are many types of metal-filament lamps available today. Signal lamps are small and are used on indication boards to show the flow of chemicals, the passage of trains past a given point, and the energizing of circuits in a definite sequence. Spot and flood lamps are made from pressed glass and are internally mirrored to radiate a defined beam of light. The flood lamp has a relatively broad beam and is used for outdoor illumination such as gardens, monuments, parks, and sports grounds. A spot lamp has a narrow beam and is found in shop windows and showcases. They are also used to highlight an object, which has a general illumination. On lamps are used in piglet and chicken rearing. They are hard-glass bulbs and are internally mirrored for use for short-periods at a time. They are also to be found in bathrooms, and in industry for drying processes (e.g. stove enameling).

Discharge lamps

The discharge lamp consists of a glass tube containing a gas. At each end of the tube there is an electrode. If a sufficiently high voltage is applied across these electrodes a discharge takes place between them. The gas now becomes a conductor and light is produced. The color of the light produced by a discharge lamp depends on the gas in the tube: Neon - red; mercury vapor - bluish-white; helium - ivory; sodium vapor - yellow.

There are a number of electric-discharge lamps available today, each of which has a particular application or advantage over another.

Low-pressure mercury-vapor

This lamp is popularly known as the 'fluorescent' lamp. It consists of a glass tube filled with mercury vapor at a low pressure. The electrodes are located at the ends of the tube. When the lamp is switched on, an arc-discharge excites a barely-visible radiation, the greater part of which consists of ultra-violet radiation. The interior wall of the tube is coated with a fluorescent powder, which transforms the ultra-violet radiation into visible radiation or light. The type of light, that is the color range, is determined by the composition of the fluorescent powder. An important aspect of the gas-discharge lamp is that the discharge has a 'negative resistance characteristic'. This means that when the temperature of the gas or vapor rises, its resistance decreases and will thus tend to draw an ever-increasing current from the supply.

The current is limited to a predetermined value by the insertion in the circuit, in series with the lamp, of a limiting resistor or choke (inductor).

There are two types of fluorescent lamp: the hot-cathode and the cold-cathode.

The hot-cathode lamp is the more common type, familiar in tube lengths of 2.5, 1.7, 1.3 m and down to 30 cm. In this type, the electrodes are heated and the voltage of operation is low or medium voltage. To assist starting, fine mercury vapor is mixed with a small quantity of argon gas. The light produced varies from 30 to 35 lm/W. The colors available from the lamp include a near-daylight and a full-spectrum light for use where colors (of wool, paints, etc.) must be seen correctly. The principal application of the lamp includes the lighting of shops, homes, factories, streets, ships, transport-uses and trains), tunnels, coal mines and caravans. The auxiliary equipment associated with the hot-cathode lamp includes.

1. The choke, which supplies a high voltage on starting (caused by the interruption of the lamp's inductive circuit), and also limits the current in the lamp when it is operating.
2. The starter.
3. The capacitor, which is fitted to correct the power factor of the circuit by neutralizing the inductive effect of the choke.

There are a number of methods used to start

lamp circuits.

The methods fall into two general groups: 'glow' starter) and those, which do not

which use a switch (sometimes called a

autotransformer to produce the high voltage

switching arrangement but rely on an

it is important to use the correct type for the size

start the lamps. With the glow-starter,

are available, it must be remembered that

Although 'universal' starter switches in fact suitable for all sizes.

The semi-resonant start circuit has the

inductor replaced by a specially wound

transformer and is used for starting fluorescent

in cold temperatures. Current flows

through the primary coil to the

thence through the secondary coil,

which is wound in opposition to it. A large capacitor is connected between the secondary and

the second cathode of the lamp. The starting current quickly heats up the cathodes and as the

circuit is mainly capacitive; this current leads the mains voltage. Because the primary and

secondary windings are in opposition, the voltage across the lamp is increased and causes the lamp to strike.

The glow-start switch consists of two separated bimetallic contact strips contained in a small

glass bulb filled with helium gas. The contacts are connected in series with the lamp

electrodes. When the circuit-control switch is closed, the mains voltage appears across the two contacts and results in a small gas discharge. The heat generated by the discharge effects the

bimetallic strips, which bend forward to meet each other. When they make contact, current flows through the lamp electrodes to heat them. The gas discharge in the bulb ceases and the strips begin to cool down. When they separate, a high voltage appears between the electrodes and the main gas discharge is started. The voltage, which now appears across the contacts in the bulb, is, during running conditions, insufficient to cause further discharge in the helium gas, and so the contacts remain open while the lamp is burning.

The instant-start or 'quick-start' method of starting fluorescent lamps consists of an autotransformer connected across the tube. Two tapings provide a small current for heating each of the electrodes. When the electrodes become hot (usually in a fraction of a second) the tube strikes. The striking or discharge is caused by the very small currents flowing from the cathodes to an external earthed strip, which runs down the length of the tube, providing a conducting path. A normal choke is used, but only for current-limiting purposes, since there is no interruption of the current on starting.

The cold-cathode lamp uses a high voltage (about 5kV) for its operation. For general lighting purposes, they are familiar as fluorescent tubes of about 2.5 cm in diameter, straight, curved or bent to take a certain form. The power consumption is generally about 24W per meter length. The current taken is of the order of milliamperes.

11.2. Practical aspects of lighting

Though many aspects of lighting or illumination are the special concern of the qualified lighting engineer, there are some, which also affect, either directly or indirectly, the electrician. These aspects are dealt with in the following sections.

11.3 Ambient temperature of lamps

The recent development in lamp sizes and the increase in ratings used in domestic, commercial, and industrial installations have led to problems resulting from the heat generated by these lamps. If a 1000W lamp is operated in an ambient temperature of 25°C, the temperature rise can be greater than 60°C. This means that if the lighting point is a pendant, the flexible cord will be in an ambient temperature of 85°C. It has always been accepted that, owing to such high temperatures near the lamp-holders, embitterment of the insulation of the cord will occur, with consequent shortening of the life of the cord. The trend in recent years has been to manufacture lamps of a size than that of the equivalent wattage previously made, so that it has become possible to use a higher wattage lamp in an existing type of fitting. For instance, whereas in the past temperatures in enclosed fittings may

have been as high as 80°C or so, it is now possible for temperatures to be as high as 130°C and even more where the ambient temperature is also high.

The IEE Regulations have recognized this problem of heat from lamps and now recommend that the choice of a flexible cord for a particular lighting duty should be based, not only on current rating, but on the ambient temperature likely to be encountered at a lighting point. Certain new heat-resisting materials are now available.

Conductors for very high temperatures are now nickel-plated copper, instead of the usual tinned-copper; some conductors are natural copper and are associated with thermoplastic insulating materials such as polythene and polyvinyl chloride (PVC). The greatest advances have been made with insulating materials. Natural rubber is now limited to use where the temperatures do not exceed 65°C. Above this limit the rubber becomes hard and the life of a cord may be as little as a year or so. Inspection of rubber insulation, which has become hard during service, has shown that it may still function as an insulator provided the cable is not fixed.

Polyethylene (polythene) has many electrical properties. But it is a thermoplastic material and deforms seriously under pressure and excessive heat. At about 110°C there is a sharp melting point when severe flow may take place with consequential electrical failure. This type of cable is not used in lamp fittings. PVC has excellent age-resisting properties, but has a low maximum operating temperature of 70°C. This type is also not used for lamp fittings, unless the ventilation is adequate.

Butyl-rubber insulation is suitable for lamp fittings where higher ambient temperatures are prevalent. The maximum permitted operating temperature is 85°C. At this temperature, the cable has a long life. At higher temperatures the insulation deteriorates rapidly. Around 130°C it turns to powder. Silicone rubber can be operated continuously at 150°C, and is used for many of the enclosed lamp fittings installed at the present time. The physical properties of this type of insulation are such that a suitable protection is necessary and a heat-resisting braid is normal for this purpose. Glass braiding with a heat-resisting lacquer is an excellent finish, but makes an expensive cable. An alternative is terylene braiding, which is considered ideally suitable for many lamp fittings. Another good heat-resistant type of finish is an impregnated glass lapping with an impregnated glass braid. The temperature of operation of this type of cable may be as high as 180°C. For enclosed lamp fittings, where temperatures of this order are obtained, this cable is a suitable answer. installations, are chlorosulphonated polyethylene (CPS or 'Hypalon') and PVC

Two sheathing materials, which are used widely in nitrile rubber (NCR/PVC) generally

known as HOFR insulants. These materials are both vulcanisable rubbers and besides having good weathering, solvent, and oil resistance, are flame retardant. They may be compounded so as to be used over an insulated conductor operating at 85°C. Another new product, which appears suitable, particularly for insulation, is ethylene propylene rubber. The age-resistance of this material is proving excellent and may well prove to be a common material in the near future.

11.4. The effect of voltage drop

The voltage applied to a lamp is reduced if the actual voltage at the lamp terminals is lower than the rated lamp voltage. Generally, the reduction in light output is more rapid than the reduction of the wattage. It is therefore not economical to run lamps at less than the rated voltage. Another aspect of reduced voltage at the lamp terminals is that financial loss can be experienced in addition to less light being available. Over-volting a lamp by 5 per cent (e.g. a 230V lamp on 242V) halves its life, as the filament is operated at a higher than normal temperature and vaporizes more rapidly. On the other hand, under-volting a lamp lengthens its life but reduces its light output without a corresponding reduction in the wattage consumed. Electricity, in effect, is being run to waste.

Voltage drop can also occur as a result of the lighting cables being too small for the current carried. This situation may arise when old wiring is allowed to supply new lamp fittings, which contain lamps with higher wattage ratings. In fact, in many modern commercial and industrial premises it is often found that with high-wattage lamps being used and long circuit runs, cables larger than the usual 1, 1.5 and 2.5 mm² are necessary.

11.5. Faults in discharge lamps

Because of their associated circuitry, containing components such as starters, chokes and capacitors, and transformers, discharge lamps may fail or fault, to show certain symptoms which can be useful in any diagnosis by the electrician sent to investigate the fault. The following is summarized information on different lamp types.

Mercury lamps. One of the first points to note about these lamps is that they require up to 5 minutes to cool before re-ignition can take place. In factory situations lamps are often extinguished because of voltage 'dips'. If a lamp fails to reignite after cooling, the ballast should be checked for over-heating and continuity. If the lamp is nearing the end of its life it will fail to re-strike and should be replaced. If the lamp delivers a poor light output, the choke should be checked for continuity. In some circuits parallel chokes are used and their currents should be equal. However, the 700W circuit uses dissimilar chokes. Some types of lamp may suffer from 'thermal shock' as the result of cold water, e.g. rain, falling onto the hot

glass envelopes. Cracked lamps (perhaps the result of damage in transit) will operate until the internal pressure falls to atmospheric when the arc tube will fail. Excessive pressure used when screwing lamps in their holders also produces faults resulting in eventual lamp failure. If the light output is unstable, a possible cause could be poor contact in the lamp holder (look for signs or arcing on the cap center contact).

11.6 Light control

Most sources radiate light in all directions, and are too brilliant to be viewed comfortably. The light must therefore be controlled to direct it where it is required and to soften its brilliance. All substances absorb some of the light which strikes or passes through them. All substances also reflect some of the light falling on them, or transmit it, or both. Reflection of light may be of three kinds:

a) Specular reflection. When light strikes a mirror-like surface it is reflected at the same angle and in the same plane as it strikes. The type of reflection is much used for the precise control of light, e.g. car headlamps, silvered shop-window reflectors. Accidental specular reflection is generally unwanted, e.g. lighting fittings reflected in glossy table tops. A mirror-like surface can look dark even though a great deal of light is striking it, and vice versa. Its appearance depends only on what is mirrored in its surface from the particular viewpoint concerned. The streakiness sometimes obtained from specular reflection is avoided by breaking up the reflector surface by ripples, flutes or dimples, by giving it a 'satin' finish, by using a pearl (or otherwise obscured) type of lamp, or by using a moulded or lightly frosted glass cover to the lamp fitting.

b) Diffuse reflection. This is the reflection obtained from a perfectly matt surface, the distribution of the reflected light being independent of the direction of the incident light. The distribution of reflected light follows the cosine law, i.e. the intensity in any direction is proportional to the cosine of the angle between that direction and the perpendicular to the surface. A surface having this characteristic appears equally bright whatever the direction of view. White blotting paper and whitewash are nearly perfect diffuse reflectors. Diffuse reflection is useless for the precise control of light, but it can be used to reflect light in a general direction.

c) Spread reflection. Depolished metals and satin-finished mirrored surfaces have reflection characteristics between specular and diffuse. Vitreous and synthetic enamels are widely used for the reflecting surfaces of lighting fittings. Vitreous enamel is the more hard-wearing.

EXAMPLE PROJECT

12.1 AREA EXPLORING, NETWORK RESEARCH, DETERMINING THE PLACE OF INLET CABLE AND DEMANDS OF PROPERTY OWNER;

We is located with the property owner. Our Streed in wich center of Lefkoşa. There is a near to building. Feeding will be done from this line, 15 m underground be used to get in the building;

Demands of property owner of illumination force were listened. He demands flourescent armature for living room, kitchen and bedrooms, J type armature for hall, C type armature for nadfoom and We. He also demanded to purchase 10000 Btu split air-conditioning got a power of 3 kW (1 kW= 3,148 Btu)

He also demanded an oven for every flats and at least two sockets for each room. He demanded heating system, solar energy, boiler, and pressure tank for each flat as well.

12.2 CONVERTING-ARCHITECTURAL PROJECT TO ELECTRICAL PROJECT, DRAWING PRELIMINARY PROJECT;

Architectural project was checked. Up through necessary arrangements. The locations of doors and windows were determined. Opening direction of the doors was drawn. Kitchen counter place and its measures were designated.

After these steps, the places of receivers in the flats were selected. Air-conditions have been installed to living room. Dishwasher and oven were shown in the kitchen and washine machine in the hall. The places for demanded armatures, sockets and keys were designated.

Architectural Plans are important to energy entrance into the building and distribution and remoting regulations. The plans which are designed by architectures and civil engineers include all the construction drawings, (1 / 50 or 1 / 200). These plans are used for construction of the building and also in electrical installation. It is clear that the buildings situation must be considered according to municipality regulations. The columns and joists are important during electrical installation in the floor plans. These parts are chosen carefully. Because reinforced concrete roof will carry all the weight of the building; so it is not liked to get any damage on the system while electrical installment has been doing. Thus **electrical** installment and reinforced concrete roof construction must be held together floor plans must showed separately.

Stairs going down to the **basement** must be considered carefully. Because of the columns and the walls situation the empty places must be used for electrical installation.

If the energy entrance through underground the first floor gets importance with the main gate or small corridor. **An** assembly space must be looked for in the entrance. The walls are thinner than basement's. Normal floor plans are shown with only one drawing because all the flats are the same so the electrical installments and architectural construction are followed the same construction.

If the energy entrance with air corridor, an isolator consoul equipment must be assembled on the wall side ~~where~~ **the** first floor's air corridor enters. The energy line will be connected to the stair holes with the shortest way. Column line fuse will also put in this place.

For studing floor plans, heat and ventilate holes must be considered carefully. During the installment these places must be stayed away. Opening side of the doors is important due to electrical remote switch settlement. The switch must not be ~~behind~~ the door. The room spaces and the other measurement must be in cm. in floor plans. These measurements will be used for calculation of the illumination.

The architectural plans are the first studies of the electrical installation. Because the application project of electrical installment has been drawn on architectural plans first. After certification of Electrical Engineers Bureau the application is ready to Start. Therefore project makers have to have a knowledge about architectural plans. For instance they have to know how to indicate the shapes and measurements, windows, stairs (wooden parts) main walls columns.

Measurement in architectural plans has been done including internal and external parts of the building according to drafting rules. The number above the axis line of the door shows the width, the other number below the axis line shows the height. It must be avoided of height places like chimneys, in order to not give any damage to the installment during preparation of projects. Because of this it has to be known the drawings of chimney in the plan.

While the preparation of electrical installment projects the using purposes have to be known in order to designate illumination features. Additionally, permanent house appliance and furnitures places must also be known. While the preparation of the electrical installment projects, the settlement plan of the building has to be asked. It is going to help for the arrangement of installment.¹

12.3 ILLUMINATION CALCULATION

Illumination calculation is performed in order to find the number of armatures necessary for rooms.

The dimensions of living room kitchen and bedroom have measured separately. [Length(a) with(b) height (h)]

Illumination calculation is done one by one for each part.

¹ Necmettin TIRBEN, *Elektrik Projeleri ve Detayları*, sayfa 87-89, ANKARA, 1973
² KTM MOB Electrical Engineering Union'ıssus page1B-19, LEFKOŞA, 2002

13.3.2 THE CALCULATION OF INTERNAL ILLUMINATION

The formulates symbols:

n = Number of light

Φ_T = Necessary total of light flow

Φ_L = Light flow of a light

k = Index of room

a = Length

b = Wide

h = The high of light resource to working table

H = The high of light resource from ground

h_1 = The high of working table from ground

E = the flow coming to working table

A = m^2 of working table

D = Dirty factory

η = the light flow coming by reflexion

The calculation of illumination by the light flow method. The calculation of internal illumination by efficiency method. This method is mostly used in internal illumination installations. As it is known the Φ_T light that comes to plane has the components Φ_L and Φ_{end} (E shows the flow coming to working table, η shows the light flow coming by reflexion)

h can be calculated easily from

$$h = H - h_1$$

formula. So that efficiency method is used in internal illumination installations. Then we can calculate value of k from

$$k = (axb)/h(a+b).$$

Now in order to understand this method let's think about an ideal room that its walls and ceiling reflects the light totally, ($\rho = \%100$) and absorbs the light completely. ($\alpha = \%100$) and no object absorbing the light in it. The E

comes out of the light sources falls on the plane S and it is absorbed there whatever the dimensions of the room, number of the lamps, settlement of the lamps, illumination system. The average illumination degree of the plane for an ideal room is

E_0 shows the average level of light of working table, Φ_0 represents the total light flow from lamps in lumen and S represents the area of the plane in m^2 . In reality some of the light flow is absorbed by walls, ceiling, and illumination devices. So that the average illumination degree of the plane is:

$$E_0 = \frac{\Phi_L \times \eta \times n}{S}$$

η factor is called the efficiency of illumination and it is a number less than 1;

$$\eta = \frac{\Phi_a}{\Phi_L}$$

Φ_a represents flow of light to plane and

Φ_L represents total flow of light that is given by light sources.

Efficiency of device is related with the illumination device. Efficiency of the room is related with geometric dimensions of room, reflection factors and colours of walls and ceiling, light distribution curves of illumination devices, height of them to plane and their places. Table 10.1 shows below in same situations that are used mostly;

Reflection	Ceiling	0,80		0,50		0,30		
Rate	Wall	0,50	0,30	0,50	0,30	0,50	0,30	
	Ground	0,30 0,1	0,30 0,1	0,30 0,1	0,30 0,1	0,30 0,1	0,30 0,1	
Room index		room efficiency						

$K = a \times b$

$h(a+b)$

0,60			0,18	0,18	0,20	0,19	0,15	0,15	0,12		0,15
0,80			0,24	0,23	0,25	0,24	0,20	0,19	0,16		0,17
1,00			0,29	0,28	0,29	0,28	0,24	0,23	0,20		0,20
1,25			0,34	0,32	0,33	0,31	0,28	0,27	0,24		0,24
1,50			0,38	0,36	0,36	0,34	0,32	0,30	0,27		0,26
2,00			0,45	0,41	0,41	0,38	0,37	0,35	0,31		0,30
2,50			0,50	0,45	0,45	0,41	0,41	0,38	0,35		0,34
3,00			0,54	0,48	0,47	0,43	0,43	0,40	0,38		0,36
4,00			0,58	0,51	0,50	0,46	0,47	0,44	0,41		0,36
5,00			0,62	0,54	0,53	0,48	0,50	0,46	0,44		0,40

This table 2

in this Table;

a; length of one side of a square room

h; height of light sources to the plane in direct and semi-direct illumination system. Height of ceiling to the plane in direct; mixed and semi-direct illumination system.

A; Situation where is ceiling is white ($\rho_T = \%80$) and walls are quite white ($\rho_o = \%50$)

B; Situation where is ceiling is quite white ($\rho_T = \%50$) and wall are dark ($\rho_o = \%30$)

If the room is a rectangle (a,b), efficiency is ;

While preparing the table 10.1, only two efficiency about illumination devices

($\eta_{ayg} = \%70$ and $\eta_{ayg} = \%80$) is taken.

If another illumination device that has the efficiency η_1 ayg is used (if is an aygıt different from %70, %80 efficensy level) , the efficiency that is found from table is multiplied with a factor of $\eta_1 \text{ ayg} / \eta \text{ ayg}$

After finding the efficiency η , light flow that goes to plane $(l)_0$, is found with the help of flow of light by illumination sources $(l)_s$. Then the average illumination level is:

$$E_o = \frac{\Phi_s}{S} \cdot \eta \cdot \frac{(l)_0}{S}$$

If the average illumination level of plane is given and total light flow that light sources give (Φ_o) is looked for ;

$$\Phi_o = \frac{E_o \cdot S}{\eta}$$

In below the dimensions of living room are given and number of armatures are found by performing necessary calculation.

ILLIMINIATION UNITS

NAME	SYMBOL	UNIT	EXPLANATION
Light flow		Lümen (lm)	It is the amount of the total light source gives in all directions. In other words it is the port of the electrical energy converted into the light energy. That is given to light source.
Light intensity	I	kandela (cd)	It is the amount of light flow in any direction. (the light flow may be constant but the light intensity may be different in various directions)
Illimination intensity	E	lux (lux)	It is the total light flow that comes to 1 m ² area
flashing	L	cd/cm ²	It is the light intensity that comes from light sources or uniform surfaces that the light sources lighten.

This table was taken from report 1 page 18, showed in references page.

ILLUMINATION EQUATION

EQVATION	SYMBOL	EXPLANATION
$n =$	n	Number of light bulbs
Φ_T / Φ_L	Φ_T	Total light flow necessary (lm)
	Φ_L	Light flow given by a light bulb.
	k	Room index (according to dimensions)
	a	Length (m)
	b	width (m)
$k = \frac{a \cdot b}{h(a+b)}$	h	Height of the light source to the working surface (m)
	H	Height of the light source to the floor (m)
	h_1	Height of the working surfaces to the floor (m)
	E	Necessary illuminations level (lux) chosen from the table
	A	Surface area that will be lighted (m ²)
	d	Installation factors 1,25 - 1,75
$\eta = \frac{0.8}{1}$	η	Efficiency factors of the installation it is chosen from the table according to wall, ceiling, floor reflection factors, type of armature chosen, room index

This table was taken from report 1 page 19, showed in references page.

FOR SALOON

$$a = 7\text{m}$$

$$b = 4\text{m}$$

$$H = 2.9\text{m}$$

$$h = 0.85\text{m}$$

$$E = 50 \text{ lux From table}$$

$$h = H - h_1 = 2.9 - 0.8 = 2.1$$

$$k = \frac{a \cdot b}{h(a+b)} = \frac{7 \times 4}{2.1(7+4)} = 1.2$$

for $k = 1,2$ $r_1 = 0,41$ is chosen from table 2

$$d = 1,25$$

$$\Phi_T = E \cdot A \cdot d / r_1 = 50 \times 28 \times 1,25 / 0,41 = 4268 \text{ Lüm} < 2 \times 2850 \text{ lüm}$$

The armature type = fluorescent lamp type = 36/40 W have been chosen.

a

FOR life room

$$a = 4 \text{ m}$$

$$b = 4 \text{ m}$$

b

$$H = 2,9 \text{ m}$$

$$h = 0,85 \text{ m}$$

$$E = 50 \text{ lük From table}$$



$$h = H - h_1 = 2,9 - 0,8 = 2,1 \text{ M}$$

$$k = (a \cdot b) / h(a + b) = (4 \times 4) / 2,1(4 + 4) = 0,95$$

for $k = 0,95$ $r_1 = 0,36$ is chosen from table 2

$$d = 1,25$$

$$\Phi_T = E \cdot A \cdot d / r_1 = 50 \times 16 \times 1,25 / 0,36 = 2777 \text{ Lüm} < 1 \times 2850 \text{ lüm}$$

The armature type = fluorescent lamp type = 36/40 W have been chosen.

a

FOR kitchen

$$a = 3 \text{ m}$$

$$b = 3 \text{ m}$$

b

$$H = 2,9 \text{ m}$$

$$h = 0,85 \text{ m}$$

$$E = 125 \text{ lük From table}$$



$$h = H - h_1 = 2,9 - 0,8 = 2,1 \text{ M}$$

$$k = (a \cdot b) / h(a + b) = (3 \times 3) / 2,1(3 + 3) = 0,95$$

for $k = 0,71$ $r_1 = 0,27$ is chosen from table 2

$$d = 1,25$$

$$\Phi_T = E \cdot A \cdot d / r_1 = 125 \times 9 \times 1,25 / 0,27 = 5208 \text{ Lüm} < 1 \times 5600 \text{ lüm}$$

The armature tipe = fluorescent lamb tipe = 65/80 W have been choosen.

The light flow for this tipe of lamb has been showed as 5600 lumen in table below.

TYPICAL FLOWS OF SOME LAMPS

TYPE OF LAMP	POWER OF LAMP (W)	AVERAGE FLOWS (lm)
GUW (GENERAL USING-WIRED)	60	610
	100	1230
	18/20	1100
	36/40	2850
	65/80	5600
FLUORESCANT	9	400
	11	600
	15	900
	20	1200
	23	1500
PL (economic)	16	1050
	28	2050
	38	3050
2D COMPACT FLOURESAN	50	1800
	125	6300
	400	12250
	1000	38000
MERCURY (MBF)	250	17000
MERCURY (MBIF)	1000	81000
H.PRESSURIZED SODIUM (SON PLUS)	100	10000
	400	54000
H.PRESSURIZED SODIUM (SON DELUXE)	150	12250
	400	38000
TUNGSTEN HALOJEN	300	5950
	500	11000
	750	16500
	1000	22000
	1500	33000

This table was taken from report 1 page 18, showed in references page.

Illumination of kitchen and bedrooms have been done in the same way. Finally the number place and power of the armatures have been calculated for each flat.²

12.4 STARTING THE FINAL PROJECT DRAWING

Situation plan has been drawn considering the location of the area where the building is standing. The inlet cable to building was designated. Force projects of first floor and other floors were drawn. Conductor cross-sections were chosen as; 1.0 mm² for light outlet, 2,5 mm² for socket outlets, 2,5 mm²-4 mm² for the line outlets, at least 16 mm² for column lines. Fuse currents that will be used in these lines were determined according to receiver currents. A line has been shown for each air-conditioner. Dishwasher and oven in the kitchen have been fed with the same line. Light 0,3 mm, socket and ground 0.4 mm thick, column lines 0.6 thick, wiring and walls 0.2 mm thick were selected in the plan. Total 16 light outlets have been fed by two line and 19 socket outlet have been fed by 9 line. The sockets in the kitchen were planned to put at least two meters away from sink and tap. The main table were planned to first floor entrance, distribution tables were planned to a suitable place in front of the inlet door. All the counters were installed into the main table. The grounding line has been done with 16 mm² copper conductor and grounding has been done with 0,5 m² copper board as stated in laws.

The indication of the line tables and characteristic features of the motors for first and the ordinary floors have been showed in the, tables at the end of this chapter.³

This is divided into various types according to materials we use in internal electricity installation:

² Prof.Dr.Muzaffer KAY A, *Aydınlatma Tekniği*, Page No Between 208-214, Birsen Publishing, 2000,istanbul

³ Zafer ÜRGÜLÜ, *Elektrobank.Elektroteknik Bilgi Bankası*Page No 350-351-352,, Bizim Büro Publishing,1997,Ankara

- 1) Installation made with conveyers with pipes
- 2) Installation with Peşel pipe
- 3) Installation with antigron (material for damp places) material
- 6) Installation on the isolators
- 5) Installation with underground cable

During construction of these installations the work order to be followed is as follows:

1) Drawing the way of the conveyer: The conveyer, should be placed in a way that will not spoil the face of the wall or the ceiling. We should place the keys to places that could easily be reached when the door is opened.

2) Opening transit holes: They should be opened by hole pens and by drills.

3) Placing the pipe collars: We should place the pipe collars with 30-50 cm intervals throughout the planned conveyer ways.

4) Placing the junction boxes: We should determine the junction boxes on the wall by pipe collars, nails, steel nails or by wooden screws on the plugs, formerly placed.

5) Placing conveyers with pipes

6) Placing sockets and keys

7) Making the connections

8) Hanging and connecting the lamps and chandeliers

For sub-plaster installation with Bergmer and Peşel pipes, the order is as follows:

First of all, we draw the way for conveyers. Then we mark places of junction boxes, keys and sockets. Then we open channels on the walls and on the ceiling for pipes. After that, we place the cases of junction boxes, keys and sockets taking the plaster thickness into consideration. We attach the pipes with screws to the channels formerly opened. We take and connect the conveyers from the pipes by the help of guidance only after plaster is made and dried.

Before the underground cables spread the conductor way must be resigned. The cable channel is opened at least 80 cm depth and 40-50 cm width. Sand must be put at least 10 cm deep of the canal cable is installed. After putting the sand on the cables bricks must be put. After that the system is buried by soil."

12.6 Calculating Power of Implement and Reduce Voltage

For a house

Water Pump 750 W 6.7 A

Sockets $5 \times 100\% + 5 \times 40\% = 7 \text{ A}$

Air condition $= 3000/240 = 12.5$ First 10 A + % 50 of last current = 11.25 A

Heater $= 3000/240 = 12.5$ First 10 A + % 50 of last current = 11.25 A

Cooker + Boudry Machine + Washing Machine =

$(2500 + 2500 + 2000)/240 = 29.1 \text{ A}$ = First 10 A + % 30 of last current = 15.73 A

Light $= (5 + 5) \times 66\% = 6.6 \text{ A}$

Total current is 58.53 A

For apartment

Water pump $= 6.7 \times 8 = 53.6 \text{ A}$

Socet $= 7 \times 100\% + 7 \times 7 \times 40\% = 26.6 \text{ A}$

Air Condition $= 12.5 \times 100\% + 12.5 \times 50\% + 12.5 \times 33\% + 12.5 \times 25\% + 12.5 \times 4 \times 20\% = 35.89 \text{ A}$

Heater $= 12.5 \times 100\% + 12.5 \times 100\% + 12.5 \times 25\% \times 6 = 43.75 \text{ A}$

Fixed Machinery $= 29.11 \times 100\% + 19.11 \times 50\% + 29.11 \times 33\% + 29.11 \times 25\% + 29.11 \times 4 \times 20\% = 84.2$

Light $= 10 \times 8 \times 50\% = 40 \text{ A}$

Total current is 254.08 A

If we can think that three house are feed from a line as R phase, a phase line has $254.08/3 \text{ A} = 84.6 \text{ A}$ total current. According this result we can chose 4x35 mm² PVC cable for main column line 2

⁴ KTMMOB's issue table 1 M

⁴ KTMMOB's issue table Diversity coefficient

12.6.1 Count of Reduce Voltage

HUP	Counter Box	Distrubeter Box	Heather
4x35 mm ² NYY 15m	2x16 mm ² PVC 12M	mm ² 10m	

H

C

D

H'

Between Hup and Counter Box

$$AU_{Hc} = g_{1xL_{1x}l_1} = 1.2 \times 1 \times 84.6 = 1528.8 \text{ mV}$$

$$_{-}U_{co} = g_{zxL_{cx}l_a} = 4 \times 12 \times 57.3 = 2750.4 \text{ mV}$$

$$A. U_{oH'} = g_{3L_{3x}h} = 16 \times 8 \times 12.5 = 1600 \text{ mV}$$

$$A. U_{1-H'} = AU_{Hc} + \sim U_{co} + A U_{DH'} = 1550 + 2750.4 + 1600 = 5879 < 6000 \text{ mV}$$

Cables are satisfy

12.7 COST CALCULATION

UNIT NO	IDENTIFICATION OF WORKING	UNID	UNITP.	TO.PRICE
A-1	Forward level light circuit	80 numr	34.200.000	2.560.000.000
A-2	Type hook light circuit	80 Num	36.800.000	2.944.000.000
A-3	Type ceiling light	80 Num	44.000.000	3.520.000.000
A-12.5	Florasas light	80 Num	92.300.000	7.384.000.000
C-1.1	1x13 A Soccet circuit	192 Nu	45.000.000	8.640.000.000
C-2.1	Heater impliment circuit	8 Num	110.000.000	880.000.000
C-2.8	Cooker kontrol circuit	8Num	98.000.000	784.000.000
C-2.5	Boundry machine circuit	8Num	73.500.000	588.000.000
C-2.6	Washing machine circuit	8Num	73.500.000	588.000.000
C-2.10	Air condition circuit	Num	73.500.000	588.000.000
C-2.11	Kitchen aspirator circuit	8Num	34.000.000	277.600.000
C-2.14	Bell circuit	8Num	68.300.000	546.400.000
C-2.16	Stair ot.	1 Num	93.200.000	93.200.000
C-2.18		1 Num	124.000.000	124.000.000
D-1.1		24 Num	49.200.000	1.180.000.000
D-1.3.4			13.300.000	13.300.000
D-1.4.4			16.200.000	16.200.000
E-1	Voltage ot.		128.000.000	1.152.000.000
E-3	Current ot		146.000.000	1.314.000.000
G-1.4	Colum line	84m	7.500.000	630.000.000
G-2.12	NYC cabbie	15 m	31.100.000	466.500.000
H-4.5	MCCB 3x160	1 Num	452.000.000	452.000.000
I.1.16		8 Num	424.000.000	3.392.000.000
J-4		15 m	122.100.000	181.500.000
TOTAL:			29.674.200.000	YTL



P -l.
 r "o
 'ü
 ~
 o, <
 o CD
 w
 r m
 r m
 q
 ::0.
 ...
 >>>>>
 "o
 ~
 c....
 m
 en

[illegible][illegible]

CONCLUSION

For an electrical engineer, the most important subject is drawing electrical installation projects. Because the engineer is imagining something that is not present and he or she has to think and apply in a very unusual and complex way. We choose a project about electrical installation. While working in the topic of electrical installation, everyone technicians or engineers should be very careful because small mistakes can cause big damages in application. In this project all regulation standards of IEE and British standards have been applied very carefully. This project indicated us nearly all critical points of drawing an electrical installation project of a complex building like a hospital. This project also showed us it is not enough to be an engineer. Also an engineer has to be a good electrical technician to clarify his mind about some critical points while drawing an electrical project.

REFERENCES

- [1] Thompson F. G., *Electrical Installation and Workshop Technology*, Volume One, 5th ed., Longman Group U.K. Limited, 1992.
- [2] Thompson F. G., *Electrical Installation and Workshop Technology*, Volume Two, 4th ed., Longman Group U.K. Ltd., 1992.
- [3] Theraja B. L., *Electrical Technology in S.I. Systems of Units*, 22nd ed., Niraja Construction & Development Co. (P) Ltd., New Delhi, 1987.
- [4] Chamber of Electrical Engineers. *Project Drawing Principles and Help Information's* book 5th ed. Nicosia; 2002